ENVIRONMENTAL COMPLIANCE STATUS REPORT FOR 1040 MW (2 x 520 MW) THERMAL POWER PLANT VISAKHAPATNAM, ANDHRA PRADESH

APRIL - SEPTEMBER 2021



HINDUJA NATIONAL POWER CORPORATION LIMITED VISAKHAPATNAM, ANDHRA PRADESH

Prepared by:



VIMTA Labs Ltd., 142, IDA, Phase-II, Cherlapally, Hyderabad-500 051, Telangana State www.vimta.com,www.env@vimta.com

PREFACE

HINDUJA NATIONAL POWER CORPORATION LIMITED

ENVIRONMENTAL COMPLIANCE STATUS REPORT FOR 1040 MW (2 x 520 MW) THERMAL POWER PLANT VISAKHAPATNAM, ANDHRA PRADESH

APRIL – SEPTEMBER 2021

For and on behalf of VIMTA Labs Limited		
Approved by	: M. Janardhan	
Signed	: MENG-	
Designation	: Head & Vice President (Environment)	
Date	: 18 th November, 2021	

This report has been prepared by **Vimta Labs Limited** with all reasonable skill, care and diligence within the terms of the contract with the client, incorporating our General Terms and Conditions of Business and taking account of the resources devoted to it by agreement with the client.

We disclaim any responsibility to the client and others in respect of any matters outside the scope of the above.

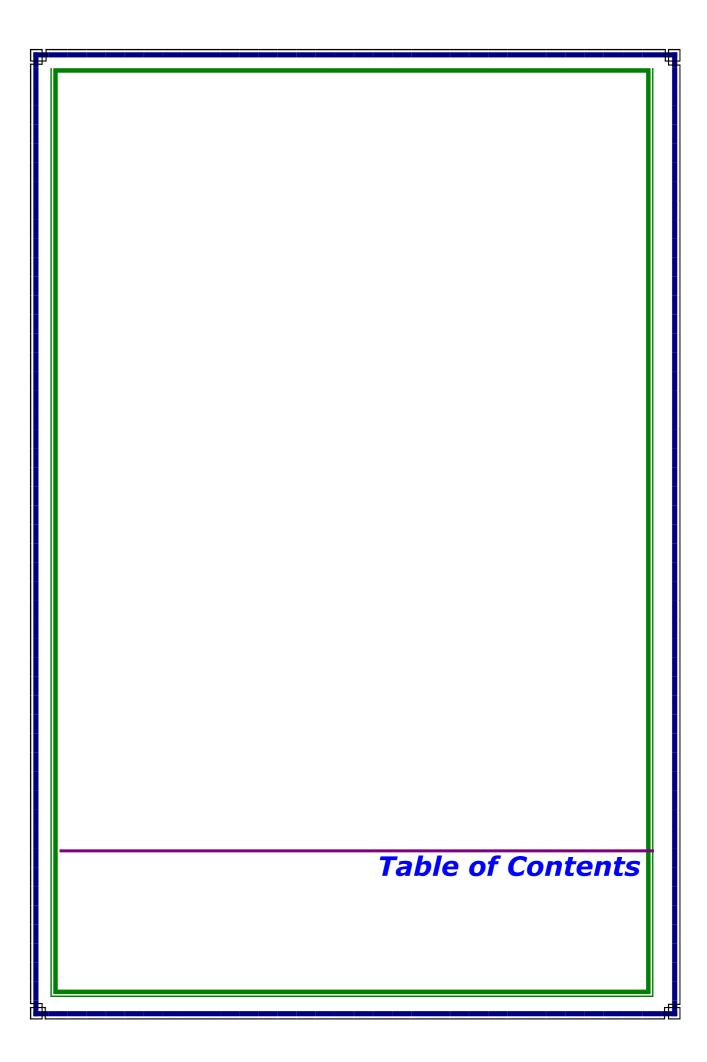


Table of Contents

- - - -

<u>Tuble of contents</u>		
Chapter #	Title	Page #
1.0	Introduction	
1.1	The Background	1
1.2	Project Setting	1
1.3	Processing Description	2
1.4	Scope of the Study	3
1.5	Compliance to Environmental Clearance	4
2.0	Compliance Status Report	8
3.0	Description of the Environment	
3.1	Meteorology	24
3.2	Ambient Air Quality	26
3.3	Fugitive Dust Emission monitoring	39
3.4	Ambient Noise Quality	39
3.5	Water Quality	42
3.6	Soil Quality	53 58
3.7 3.8		58 58
3.9	5	59
3.10	5	59
3.11		60
	Annexure Annexure – I Ambient Air Quality Levels Annexure – II Water Balance Diagram	
List	of Figures	
1.1	Geographical Location Map	5
1.2	Location Map-10KM Radius	6
1.3	Plant Lay out Plan	7
3.1	Wind Rose (April – September 2021)	25
3.2	Air Quality Sampling Locations	27
3.3	Noise Monitoring Locations	41
3.4	Water Sampling Locations	43 M
3.5	Shoreline Satellite Imagery of HTSL, Resourcesat 2 L4FMX-5 (21 April 2021)	™ 62
3.6	Hnpcl Jetty and Profile Locations On Google Earth Map	63
	0Beach profile-From Jetty 11.03.2021	65-68
3.11	Site Photos graphs of Beach Profile Study Area	69

Table of Contents

Table of Contents

Table of Contents (Contd..)

Chapter

Title

Page

List of Tables

3.1	Meteorological Data Generated at Project Site	24
3.2	Details of Ambient Air Quality Monitoring Locations	28
3.3	Techniques Used For Ambient Air Quality Monitoring	31
3.4	Summary of Ambient Air Quality Data	
	(April – September 2021)	37
3.5	Summary of Ambient Air Quality Data	
	(April – September 2021)	38
3.6	Fugitive Dust Monitoring Results (April – September 2021)	39
3.7	Ambient Noise Monitoring Locations	39
3.8	Ambient Noise Level Monitoring Results	
	(April – September 2021)	40
3.9	Noise level monitoring results inside the plant	40
	(April – September 2021)	
	Water Quality Sampling Locations	42
	17Ground Water Quality for April – September 2021	44-50
3.18	Surface Water Quality	
	(Marine water) (April – September 2021)	51
3.19	Surface Water Quality	
	(Creek Water) (April – September 2021)	52
	24Soil Quality Results (April – September 2021)	53- 57
	ETP Outlet Analysis Result At Plant Site	58
3.26	5	58
3.27	2	59
	Sewage Water Quality (April – September 2021)	59
3.29	Details of Profiles On 11.03.2021	64



Chapter-I Introduction

1.0 INTRODUCTION

1.1 The Background

Hinduja National Power Corporation Limited (HNPCL) is part of Hinduja Group to realize the ambitions of the Group in Power Sector. HNPCL is planning to create a power generation capacity of 10,000 MW over the next ten years at an expected investment of over \$10 billion across India. The total projected capacity will be a mix of thermal, hydro, nuclear and renewable energy.

As a first step in power sector, HNPCL is setting up a 1,040 MW coal based merchant power plant and is located on the coast of the Bay of Bengal at Palavalasa, Pedagantyada Mandal, Visakhapatnam District in the State of Andhra Pradesh, India. The project configuration is 2x520 MW.

The earlier Environmental Clearance (EC) has been confirmed from Ministry of Environment & Forests, Consent for Establish (CFE) and Consent for Operation (CFO) from Andhra Pradesh Pollution Control Board (APPCB) has been obtained.

Hinduja National Power Corporation Limited (HNPCL) has retained M/s VIMTA LABS LIMITED, Hyderabad to undertake Environmental Data Generation for various environmental factors on monthly and seasonal basis, which may be affected due to the likely impact arising out of the existing Power plant. Environmental data has been collected for various environmental components viz. Air, water, Noise and Soil quality during April to September 2021 and prepared compliance to Environmental clearance involved by MOEF vide Letter No:J-13011/11/90-IA-II(T) dated 3rd September, 1996, No: 1-13012/92/2008.IA.II(T) dated 4th March 2009, No. J 13012/92/2008-IA.II(T) dated 10th June 2010 and CRZ Clearance vide letter F. No 11-58/2011-1A-III dated 3rd January 2014, F. No: 11-58/2011-IA-III dated 17/19th March, 2015, Letter No: 245/Env/CZMA/2015, dated 05th June, 2015, F. No: 11-58/2011-IA-III dated 01th October, 2015, F. No: 11-58/2011-IA-III dated 01th 2019, 2015 (Amendment), CFO No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06th March, 2020.

1.2 Project Setting

The existing plant is located in Palavalasa, Pedagantyada Mandal, Visakhapatnam District of Andhra Pradesh and the same is identified on the survey of India toposheet no 65 O/2, O/6 at the Latitude $17^{0}34'30''$ North and Longitude $83^{0}07'30''$ East at an elevation of 8.5 m above Mean Sea Level (MSL).

The present study of various environmental attributes establishes the post operational characteristics and this will help in identifying the incremental concentrations if any, due to the operation of the existing plant.

The geographical location of the plant is shown in **Figures-1.1.** The topographical features of the project area (within 10 km radius of plant site) are depicted in **Figures-1.2.**

Chapter-I Introduction


The long-term data recorded at India Meteorological Center at Visakhapatnam indicates temperature in the range of 15.8°C to 37.7°C. The mean total rainfall is about 1300 mm for the whole year. The relative humidity is generally high during the period from September to January and is least during the summer afternoons.

The predominant wind direction and wind speed as recorded by IMD Visakhapatnam during the winter season are E (32.4%) followed by ESE (19.9%) and during the Pre monsoon season are SW (42.5%) followed by SSW (35.8%). This variation in wind pattern can be attributed to the hilly terrain prevailing in the region. The Relative Humidity was observed to be in the range of 63 to 80% during the winter and Pre monsoon seasons.

1.3 Process Description

Each of the coal-fired power projects currently in development would employ pulverized coal combustion (PCC) technology. In the PCC process, the coalhandling plants receive coal, crush it to the required size and feed it to the boiler plants. The boiler plants then use coal pulverisers to grind the coal to a finer size before it is fed to the boiler furnace. The boilers are enclosures encased by tubes filled with flowing water. As the boiler furnace heats, the water flowing in the boiler tubes is converted into high pressure and high temperature steam. This steam is conveyed to the turbine through steam pipelines. The steam produced in the boiler drives steam turbines, making the turbines' rotors rotate at high speeds. Alternators are coupled to the steam turbines and rotate with the turbines' rotors. The alternators convert the energy generated by the rotation of the turbines' rotors into electricity. Step-up transformers then steps up the voltage of generated electricity before it is fed to the grids for transmission. Transmission of electricity is done at very high voltage to minimize transmission losses.

The coal-fired power process is illustrated below:

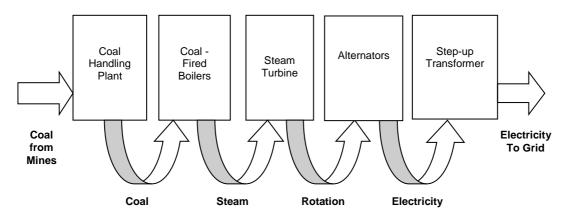

The process of generation of power from coal (water steam cycle) essentially entails two main stages. In the first stage, the chemical energy stored in coal is converted into heat energy in the coal-fired boilers. In the second stage, the high-pressure steam, which is generated in the boilers, is passed through turbines (conversion of heat energy into mechanical energy) which in turn is coupled to generators (conversion of mechanical energy into electrical energy), thereby generating electricity.

Chapter-I Introduction

The water steam cycle essentially contains the coal fired steam generator, the steam turbine with condenser, feed-water tank, low-pressure (LP) heaters and high-pressure (HP) heaters and the connecting pipelines. The superheated steam produced in the steam generator is supplied to the steam turbine, which drives the three-phase AC generator. After leaving the HP turbine, the steam is reheated in the steam generator and fed to the Intermediate Pressure (IP) turbine. In the LP turbine the steam coming directly from the IP turbine expands to condenser pressure and is condensed in the condenser.

Once through system is used for cooling of the condenser. The condensate collected in the condenser hot well is discharged by the condensate pumps and supplied via the LP condensate heaters into the feed water tank. The feed water is further heated by bled steam from turbine and dissolved gases from the feed-water are liberated. The boiler feed pumps discharge feed water from the feed-water tank via the HP heaters to the economizer. Steaming starts from this point onwards. The high temperature steam-water mix is further converted into steam in water walls and finally passed through the super heaters sections for converting the saturated steam into superheated steam.

The power station would be designed with two power generating units of 520 MW each, along with the auxiliaries and common utility services like plant water system, coal handling system, ash handling plant, and switchyard for power evacuation, plant electrical system and workshop.

The main sections of the power generating unit include Steam Generator along with milling system and electrostatic precipitator, integral piping, integral control system, turbine and generator unit, boiler feed pump, regenerative heaters, condensate extraction pump, circulating and auxiliary cooling water pumps and the generator transformer with bus duct. The main sections of the utility system are the coal handling system, ash handling system, fire fighting system, AC & Ventilation system, switchyard and the plant water system. The power generated at lower voltage of 21 KV would be stepped up to 400 KV and will be connected to the proposed 400 KV switchyard for dispatch.

The plant layout is shown in **Figure-1.3**.

1.4 Scope of the Study

Under the scope of the study, an area of 10 km radius from the centre of the existing plant was covered in detail for various environmental components viz Air, water, Noise and Soil based on the guidelines of Ministry of Environment and Forests, Government of India.

1.4.1 <u>Micrometeorological data</u>

The meteorological and micro-climatic parameters were also recorded simultaneously using automatic weather station located within the plant site. Wind speed, Wind Direction, Relative Humidity and Rainfall were recorded on hourly basis during the study period. Minimum and maximum temperatures were also recorded.

1.4.2 <u>Air Environment</u>

The baseline status of the existing ambient air quality within the study region has been assessed through a monitoring network of Eight Ambient Air Quality (AAQ) sampling stations during study period (April – September 2021). The monitoring network has been established depending on the available climatological norms of predominant wind directions and wind speeds of the study region in the Post monsoon, winter and part of Pre monsoon season. The baseline status of air environment was monitored for Fine Respirable Particulate Matter (PM2.5), Respirable particulate matter PM10 (RPM) and gaseous pollutants like Sulphur dioxide (SO₂), Nitrogen dioxide (NO₂) and Carbon monoxide (CO), Ammonia (NH₃), Ozone (O₃), Benzene (C₆H₆) and metals like Benzo(a)pyrene, Lead (Pb), Arsenic (As) and Nickel (Ni).

1.4.3 Fugitive Dust Emission Monitoring

Fugitive dust emission monitoring was carried out at 5 locations within the plant site to assess the uncontrolled emissions from the sources like dust handling areas, construction areas and roads etc.

1.4.4 <u>Water Quality</u>

Information on water resources (ground) was collected during the study period. The parameters of prime importance were selected under physical, chemical, inorganic, chemical organic and heavy metal groups. Samples were collected for basic nutrient demand; toxic parameters and baseline data on bacteriological aspects were also collected from the existing dug and bore wells. Open well and bore well samples were collected within 10 Km around the existing site.

1.4.5 Noise Quality

A detailed survey on noise environment was carried out in and around the project site to study the levels of noise, as the high dB (A) levels may cause adverse effect on human beings and associated environment. Spot noise levels were measured using a precision noise level meter, at residential areas, schools, hospitals, bus stands and commercial centers etc. The major noise generating sources were identified in the existing plant and were monitored to study noise environment. Ambient noise levels were measured at 8 locations in 5 Km radial distance.

1.5 Compliance to Environmental Clearance

Compliance to Environmental Clearance obtained for 2x520 MW Thermal Power Plant near Visakhapatnam. Vide Letter No: J-13011/11/90-IA-II (T) dated 3rd September, 1996 and

CRZ Clearance for the Seawater intake & outfall system and Rail line for Coal transport at palavalasa, Visakhapatnam Vide Letter F.No: 11-58/2011-IA-III dated 3rd January, 2014 and 17/19th March, 2015.

Consent Order No:APPCB/VSP/VSP/19/HO/CFO/2020, dated: 06thMarch, 2020. A compliance Status Report is prepared for 6 months' period from April - September 2021 is given in Chapter-2.

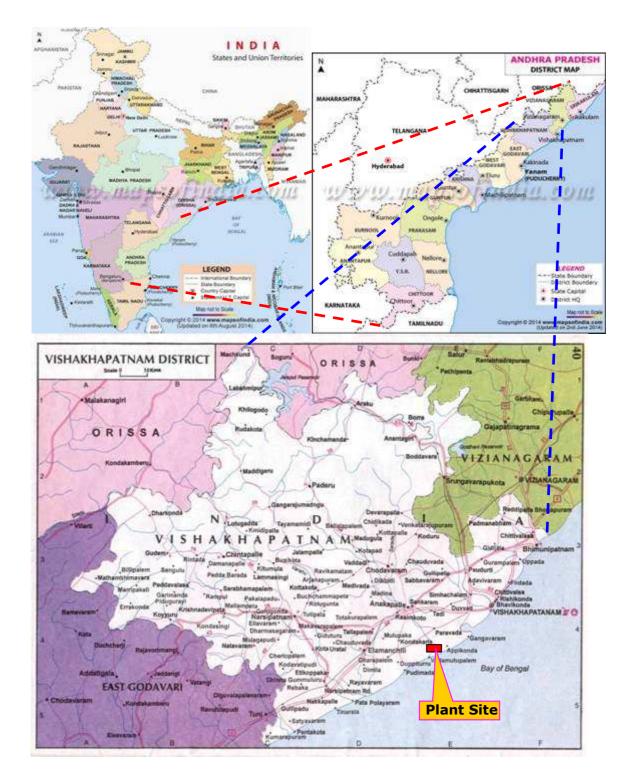


FIGURE-1.1 GEOGRAPHICAL LOCATION MAP

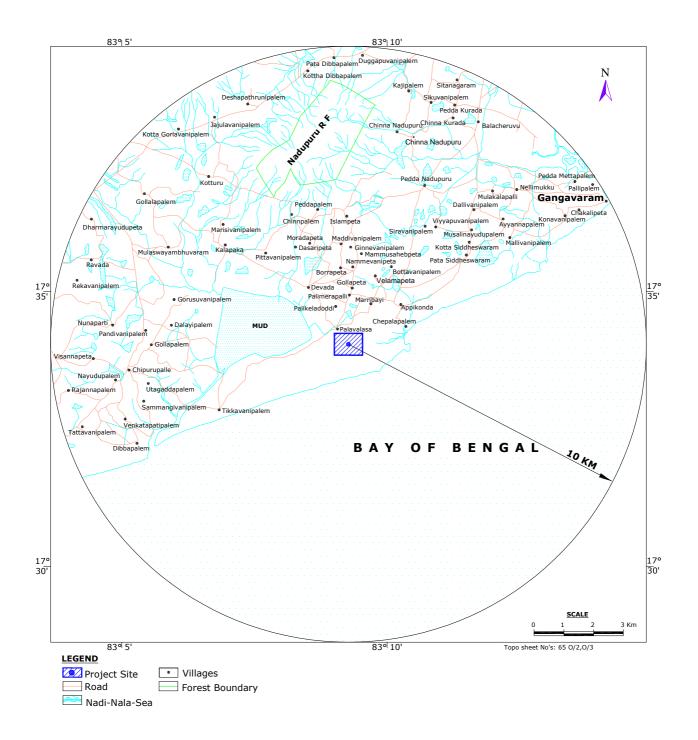


FIGURE-1.2 LOCATION MAP-10KM RADIUS

Chapter-I Introduction

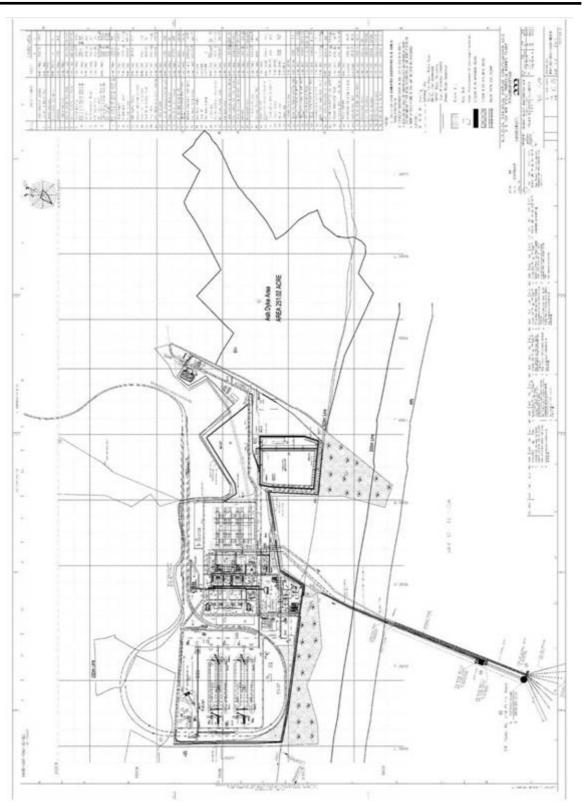


FIGURE-1.3 PLANT LAYOUT FOR HNPCL'S 2 X 520 MW THERMAL POWER PLANT AT VISHAKAPATNAM

VIMTA Labs Limited, Hyderabad



Chapter-2 Compliance Status Report

COMPLIANCE STATUS REPORT – APRIL TO SEPTEMBER 2021

<u>Ref:</u> Environment Clearance & Amendments to Environment Clearance Letter and Consent for Operation as mentioned below:

1. Letter No: J-13011/11/90-IA-II(T) dated 3rd September, 1996

- 2. Letter No: J-13011/11/90-IA-II(T) dated 10th September, 1996
- 3. Letter No: J-13011/11/90-IA.II dated 15th November, 1996
- 4. Letter No: J-13011/11/90-IA.II(T) dated 20th April, 1999
- 5. Letter No: J-13012/92/2008.IA.II(T) dated 4th March, 2009
- 6. Letter No: J-13012/92/2008-IA.II(T) dated 10th June, 2010
- 7. F. No: 11-58/2011-IA-III dated 3rd January, 2014
- 8. F. No: 11-58/2011-IA-III dated 17/19th March, 2015
- 9. Letter No: 245/Env/CZMA/2015, dated 05th June, 2015
- 10. F. No: 11-58/2011-IA-III dated 01st October, 2015
- 11. F. No: 11-58/2011-IA-III dated 01st October, 2015 (Amendment)
- 12. Consent Order No: APPCB/VSP/VSP/19/HO/CFO/2020- dated :06th March, 2020

Sr. No.	Condition (Letter No: J-13011/11/90-IA-II(T) dated 3 rd September, 1996)	Status
Specific	Conditions	
i)	All the conditions stipulated by Andhra Pradesh Pollution Control board vide their letter No.19/PCB/ C.Estt./RO/VSP/AEE/V111/95-4433 dated 13 th November, 1995 should be strictly implemented	Noted and are being complied as applicable. A monthly environmental monitoring report is being submitted to APPCB every month.
ii)	A bi-flue stack of 275 m with continuous stack monitoring system should be installed.	A bi-flue stack of 275 m has been constructed with continuous stack monitoring system.
iii)	Electrostatic precipitator having efficiency of not less than 99.8% should be installed and it should be ensured that particulate emissions would not exceed the prescribed limit of 150 mg/Nm3.	An ESP with 99.8% efficiency has been installed to control the Particulate matter emissions below 50 mg/Nm3.
iv)	Once through cooling system should be provided and the rise in temperature should be maintained within 7 degrees centigrade of the ambient water. The proposed pipeline for sea water intake and outlet should conform to the regulations of the coastal zone notification of February, 1991. Desalination plant should be provided for meeting the water requirement of the power project and other auxiliary activities.	 Water balance of the power plant enclosed as Annexure-II (Please check with HNPCL Engineering for Latest WBD). We have obtained the CRZ clearance from MoEF has been obtained for sea water intake//outfall system. Once through cooling system has been designed to maintain temperature differential within 7 deg centigrade over and above the ambient temperature of receiving water body and being maintained the same during operation of the Plant. Desalination plant with a capacity of 12.5 MLD has been installed to meet the sweet water
		requirement.
v)	Adequate space should be provided for installation of flue gas desulphurization plant	Space provision for installing FGD if required, has been provided in the plant layout in future for

Sr. No.	Condition (Letter No: J-13011/11/90-IA-II(T) dated 3 rd September, 1996)	Status
	in future for control of sulphur dioxide.	control Sulphur dioxide, if necessary.
vi)	Acquisition of land should be restricted to 2682 acres including 890 acres for ash disposal.	Complied. The plant has been established in an area of 723 acres including ash pond.
vii)	Only beneficiated coal to the tune of 16080 MT/day should be used with ash content not exceeding 34%. Fly ash generated should be collected in dry form in silos and fully utilized in a phased manner. As indicated in the Environmental Management plan, increase in the dyke height above 8 m should be undertaken through use of fly ash. For avoiding contamination of ground water, ash pond area should be suitably lined and dyked. As provided in the layout, adequate space should be earmarked for getting up of ash user plants to avoid long distance transportation to fly ash.	 MoEF vide its letter mentioned in Ref:3 has modified this condition to be read as "Only beneficiated coal to the tune of 16080 metric tonne.s/day should be used with average annual ash content supplied by Mahanadi Coalfields Limited not exceeding 34+ or - 1-2%. Fly ash generated should be collected in dry form in silos and fully utilized in a phased manner. As indicated in the Environmental Management plan, increase in the dyke height above 8 m should be undertaken through use of fly ash. For avoiding contamination of ground water, ash pond area should be suitably lined and dyked. As provided in the layout, adequate space should be earmarked for getting up of ash user plants to avoid long distance transportation to fly ash." Further vide letter mentioned in Ref:4 MoEF has accorded "no objection to the use of fuel from alternative sources which will have the same coal quality as beneficiated coal". With respect to the above we confirm that: Total coal expected to be used in a day will be well within the quantity recommended. Fly ash will be fully utilized in a phased manner as mentioned in the condition. Ash pond is being lined with HDPE to prevent contamination of ground water. Further the Ground water monitoring is being undertaken by a third party on Monthly basis as per the monitored data the levels are within permissible limits. Pond ash and Fly ash will be utilized by the following Agencies: Simhadri Constructions. Ashok buildcon Itd. Dilip buildcon Itd.
viii)	Noise level should be limited to 85 dBA and regular maintenance of equipments be undertaken. For people working in the area of generator halls and other high noise areas, ear plugs should be provided.	Noise levels are being monitored by third part at locations within the plant area and the results are within prescribed limits. Requisite personnel protective equipment has already been provided to people working in high noise areas.
ix)	For controlling fugitive dust, regular sprinkling of water in coal handling and other	Dust Suppression system installed and regular sprinkling of water on coal in stock yard and

Sr. No.	Condition (Letter No: J-13011/11/90-IA-II(T) dated 3 rd September, 1996)	Status
	vulnerable areas of the plant should be ensured.	conveyors is being ensured.
x)	Afforestation plan should be formulated in consultation with the local DFO and implemented by creating a greenbelt of 500 m along the sea side from High Tide Line. A strip of greenbelt of 150-200 m should also be created along the ash pond area and about 100 m in available spaces within the colony along the road etc. A norm of 1500-2000 trees per ha should be followed and aftercare and monitoring should also be ensured.	The power project including ash pond is restricted to 533 acres. Presently green belt is being developed in and around the power project area and an area of 249.14 acres has already been developed. Further development of Green belt continues.
xi)	Continuous monitoring of ground water should be undertaken by establishing good network of observation wells in consultation with the Central ground water board. Results and data collected should be analysed to ascertain the status of water quality and findings should be submitted for evaluation.	Continuous ground water monitoring is being carried out at seven locations on Monthly basis and the monthly data is being submitted to APPCB. As per the results the limits are within the prescribed norms. The same has been compiled and is enclosed in Chapter-3 , Section-3.5 .
xii)	All effluents generated in various plant activities should be collected in the Central Effluent Treatment Plant and treated to ensure adherence to specified standards of discharge. The concept of zero discharge should be adopted to a maximum possible extent.	Complied. All the effluents generated are being treated in the Effluent Treatment Plant (ETP). The outflow is being monitored by continuous monitoring system. Zero discharge has been adopted to the maximum possible extent.
	Keeping in view the fact that 2x500 MW thermal power plant by M/s. National Thermal Power Corporation limited proposed in the vicinity of 1040 MW thermal power project, common facilities for coal transportation, laying of rail lines etc. should be worked out with mutual consultation to avoid duplication of facilities and acquisition of additional land.	Noted For coal transportation, the facilities are being explored with NTPC and discussions are under progress.
xiv)	A financial provision of Rs. 250 crores should be provided for implementation of environmental mitigative measures with adequate scope for its enhancement in future. These funds should not be diverted for any other activities and separate account should be maintained.	Noted
xv)	Regular monitoring for SPM, SO_2 and NOx around the power plant may be carried out and records maintained. The data also collected should be properly analysed and submitted to the Ministry every six months.	Monitoring is being carried out at eight ambient air quality monitoring stations within the 10 km radius study area from the existing power plant complex, with two in the predominantly downward wind direction.
		Data on ambient air quality is being submitted to APPCB on monthly basis and also to the regional office of MOEF. As per the AAQ data, the results are within limits. The same has been compiled and is enclosed in Chapter-3 , Section-3.2 .

Sr. No.	Condition (Letter No: J-13011/11/90-IA-II(T) dated 3 rd September, 1996)	Status
xvi)	Full cooperation should be extended to the Scientists/officers from the Regional Office of the Ministry at Bangalore and also to the State Pollution Control Board who would be monitoring the compliance of environmental status. Complete set of impact assessment report and the Management Plans should be forwarded to the Regional Office for their use during monitoring.	Noted.
xvii)	Monitoring committee should be constituted for reviewing the compliance to various safeguard measures by involving recognized local NGOs, Pollution Control Board experts etc.	Internal Environmental Monitoring Committee is in place.
3	The Ministry reserves the right to revoke the clearance if conditions stipulated are not implemented to the satisfaction of the Ministry	Noted
4	For any deviation or alteration in the project proposed from those submitted to this Ministry for clearance, a fresh reference should be made to the Ministry to assess the adequacy of the conditions imposed and to add additional environmental protection measures required, if any.	Noted
5	The above stipulations would be enforced among others under the Water (Prevention and Control of Pollution) Act, 1974, the Air (Prevention and Control of Pollution) Act, 1981 the Environment (Protection) Act, 1986, the public liability Insurance Act, 1991, the Impact Assessment Notification of January, 1994 and its amendments.	Noted

Ref Letter No J-13012/ 92/2008. IA.II (T) dated 4 th March, 2009		
S.No.	Conditions	Compliance status
6	Map indicating CRZ area duly certified by the approved agency and authenticated by the state coastal zone management authority may be submitted on Top priority.	Map has already been submitted to MOEF,
7	Compliance status w.r.to stipulated EC conditions should be uploaded in the company web site and updated twice in a year and the same will also be sent by e-mail to the MOEF regional office located at Bangalore.	Six monthly compliance reports are being regularly uploaded on the company web site. The link is as below. <u>http://www.hindujanationalpower.com/images</u> <u>/compliance-status April - September 2021 -</u> <u>website-version.pdf</u>
8	The ambient levels of criteria pollutants (SO2, NOX & SPM) should be uploaded and displaced on your website and also at a convenient place in the plant premises periodically.	Display is kept at the entrance of power project.

Sr. No	Condition (Letter No: 11/58/2011 IA.III dated 3 rd January, 2014)	Compliance Status
SPECIF		
(i)	"Consent for Establishments" shall be obtained from State Pollution Control Board under Air and Water Act and a copy shall be submitted to the Ministry before start of any construction work at the site.	"Consent for Establishment" was issued by state pollution control board vide their order no 19/PCB/C.ESTI/RO/VSPI AEE- VIII/95 -4433 signed dated 13/11/1995 and complied with.
(ii)	Shall maintain the existing vegetation cover in the area between HTL and 500m line which is approximately 180 acres, belonging to government, located adjacent to the project area, in consultation with the State Government and there shall be no industrial development with in this area as committed.	Existing plantation is being maintained between HTL and 500 m line. Additional 5 acres of land has been developed.
(iii)	The railway line has been shifted from mud flat area and as per the modified line only 160m is with in mud flat area as against the original plan on 1500m. Railway line in CRZ area shall be on stilt.	Noted. Correction in the design has been done for implementation and as per revised proposal length of Railway line in CRZ3 area is 0.375 Route Km and Railway line does not pass through CRZ1 area or Inter tidal waters of mud flat.
		The proposal was approved by MOEF&CC vide letter

Sr. No	Condition (Letter No: 11/58/2011 IA.III dated 3 rd January, 2014)	Compliance Status
		No.F.No.11-58/2011-IA-III dated:1 st October, 2015.
(iv)	There shall be no construction in mudflat except part of railway line on stilt as committed.	Noted. Shall be complied with.
(v)	Adequate spare diffuser arms for operation and maintenance of the marine outfall systems shall be Provided.	Noted
(vi)	Pipelines shall be laid with more care to minimize the impact to sand dunes	Noted.
(vii)	The double story switchgear, electro chlorination building and two numbers of storage tanks Proposed between 200 and 500 m from HTL shall be located beyond 500 m from HTL as committed.	Complied. The electro chlorination building and the storage tanks have been constructed beyond 500 m from the HTL with in the plant premises.
(viii)	Periodic monitoring of water quality in terms of temperature chlorine content if applicable, salinity etc at the outfall locations shall be carried out. If the impact of temperature and salinity is found significant in future, necessary remediation measures shall be taken by extending the outfall as well as the intake lines and/or providing augmentation in inland cooling facilities.	Periodic monitoring of water quality is going on at outfall location. Agreed.
(ix)	Installation of trash bar/screens shall be put in place at the intake well to avoid fish entrapment	Complied. Trash rack has been installed.
(x)	All the conditions laid by the SCZMA shall be strictly adhered to.	Agreed
(xi)	Construction activity shall be carried out strictly as per the provisions of CRZ Notification, 2011. No construction work other than those permitted in Coastal Regulation Zone Notification shall be carried out in Coastal Regulation Zone area.	Agreed
(xii)	The project shall be executed in such a manner that there shall not be any Disturbance to the fishing activity.	Noted. There is no disturbance to fishing activity
	It shall be ensured that there is no displacement of people, houses or fishing activity as a result of the project	Shall be ensured
(xiii)	The project proponents shall set up separate Environment management cell for effective implementation of the stipulated environmental Safeguard under the supervision of a Senior executive.	Environment management cell is in place to monitor the implementation on continuous basis.
	The funds earmarked for environment management shall be included in the budget and this shall not be diverted for any other purposes.	Noted.
General	Conditions	
Sr.No	Condition (Letter F.No: 11-58/2011-IA-III dated 3 rd January, 2014)	Compliance Status
(i)	Appropriate measures must be take while undertaking digging activities to avoid any likely degradation of water quality.	Noted.
(ii)	Full supports shall be extended to the officer of this Ministry/Regional office at Bengaluru by the project	Noted.

Sr. No	Condition	Compliance Status
	(Letter No: 11/58/2011 IA.III	
	dated 3 rd January, 2014)	
	proponent during inspection of the project for monitoring	
	purposes by furnishing full details and action plan	
	including action taken reports in respect of mitigation	
	measures and other environment protection activities.	
(iii)	A six-Monthly monitoring report shall need to be	Noted and being complied with.
	submitted by the project proponents to the Regional	
	Office of this Ministry at Bengaluru regarding the	
	implementation of the stipulated Conditions.	
(iv)	Ministry of Environment & Forests or any other	Agreed.
	competent authority may stipulate any additional	
	conditions or modify the existing ones, if necessary in	
	the interest of environment and the same shall be	
	complied with.	
(v)	The Ministry reserves the right to revoke this clearance if	Noted
	any of the conditions stipulated are not complied with	
	the satisfaction of the Ministry.	
(vi)	In the event of a change in project profile or change in	Noted
	the implementation agency, fresh references shall be	
	made to the Ministry of Environment and Forests.	
(vii)	The project proponent shall inform the Regional office as	Complied.
	well as the Ministry, the date-of financial closure and	
	final approval of the project by the concerned Authorities	
	and the date of start of land Development work.	
(viii)	A copy of the clearance letter shall be marked to	Agreed.
	concerned Panchayat/local NGO, if any, from whom any	
	suggestion /representation has been Made received	
	while processing the Proposal.	
(ix)	State Pollution Control Board shall display a copy of the	NA
	clearance letter at the Regional Office, District Industries	
	Center and Collector's Office/ Tehsildar's office for 30	
	days.	

Sr. No.	Condition (Letter No: F.NO. 11-58/ 2011-IA.III dated 17/19 th March 2015)	Compliance Status
(i)	Railway line, in the CRZ, shall be on embankment with clear openings or on stilt so as to ensure free flow of water.	Noted. Being complied with.
(ii)	PP shall get an expert opinion on the design of alignment on CRZ area on embankment with clear openings or on stilt so as to ensure free flow of water and submit to Ministry prior to commencement of Railway line work in CRZ area.	Noted
(iii)	The water bodies present adjacent to the proposed to the Railway alignment shall not be disturbed.	Noted. Shall be adhered to.

Sr. No.	Condition (Letter No: F.NO. 11-58/ 2011-IA-III dated 01 th October 2015) (Amendment in CRZ Clearance-reg)	Compliance Status
(i)	All the conditions/recommendation stipulated by	Noted. Details are furnished
	Andhra Pradesh Coastal zone Management Authority	below
	(APCZMA) vide letter No.245/Env/CZMA/2015 dated	

Sr. No.	Condition (Letter No: F.NO. 11-58/ 2011-IA-III dated 01 th October 2015) (Amendment in CRZ Clearance-reg)	Compliance Status
	05.06.2015 shall strictly be complied with	
(ii)	All the condition stipulated in the clearance vide letter No.11-58/2011-IA-III dated 3 rd January, 2014 and subsequent amendment dated 17 th March, 2015 shall remain unchanged.	Noted and complied as detailed above

Sr. No.	Condition (Letter No: F.NO. 11-58/ 2011-IA-III dated 01 th October 2015) (Interim arrangement for the sea water intake and outfall system-reg)	Compliance Status
(i)	All the conditions/recommendation stipulated by Andhra Pradesh Coastal zone Management Authority (APCZMA) vide letter No.245/Env/CZMA/2015 dated 06.07.2015 shall strictly be complied with	Noted. Details are furnished below
(ii)	All the condition stipulated in the clearance granted by this Ministry vide letter No.11-58/2011-IA-III dated 3 rd January, 2014 and subsequent amendment dated 17 th March, 2015 shall remain unchanged.	Noted and being complied with
(iii)	The PP shall use multi diffuser in the outfall. As suggested by NCSCM, the thermal water shall be release at 10 m depth from the 8 diffuser.	Noted and being complied with
(iv)	A monitoring system shall be deployed by the PP to assess the movement of thermal plume in and around the outfall coolant water jetty due to the occurrence of thermal plume oscillation in south-north direction during monsoon and also to monitor the impact of hot water discharge in to the sea water flora and fauna. The PP shall comply with at the direction of the APCZMA and take necessary corrective measures wherever required.	Noted and being complied with. Hydro dynamic Studies, dispersion modeling studies for Intake and Outfall discharge studies are being carried out by Environ software(P) Ltd and the same is submitting to the concerned parties
(v)	The PP shall take all necessary clearance from the concerned authorities viz-a-viz from the concerned State Pollution Control Board	Noted and being complied with
(vi)	Care should also be take to ascertain minimal impact on the shore line change due to construction of coastal structures. For this purpose, shoreline change shall be monitored using the satellite imaginary and by beach profile studies at regular intravels.	Noted and being complied with

Sr. No.	Condition (Letter No: 245/Env/CZMA/2015, dated 05th June 2015)	Compliance Status
1	The proposed pipeline shall conform to the norms prescribed in the CRZ Notification issued by the Ministry of Environment and Forests, Government of India S. 0. No.19(E), dated 06-01-2011	Complied
2	No activity on the ground shall be undertaken without obtaining Environmental Clearance from the Ministry of Environment and Forests, Government of India as per S. 0. No.19(E), dated 06-01-2011 and the	Noted

Sr. No.	Condition (Letter No: 245/Env/CZMA/2015, dated 05th June 2015)	Compliance Status
	amendments issued thereof	
3	There shall be minimum disturbance to the sand dunes and other vegetation	Noted
4	On account of inversion process occurring along the Vizag coast, wherein the temperature profile gets reversed in such a way that bottom temperature tend to become higher than surface temperature on seasonal basis. Hence, it is suggested that a constant monitoring system shall be established to monitor the physical, chemical and biological activity near the outfall point and its surroundings. The industry shall take necessary steps to attain the safe diffusion of used ballast sea water discharged through outfall system	Temperature is Regularly monitoring at discharge points. All necessary measures has taken for safe discharge of ballast sea water.
5	Marker buoy and light indicators shall be established close to the intake and outfall points to avoid fishing net damage	Exploring the suitable items from market.
6	Residual chlorine in the return water shall be kept at a very low concentration at discharge point. If possible, de-chlorination by hypo may be taken up before disposal of warm water into the sea	Residual chlorine is observed within limit. (<0.2ppm).
7	Additional diffusers shall be installed to enhance the dispersion of the hot water to facilitate the dissipation of temperature	Noted.
8	Regular monitoring of water quality at bottom and surface shall be carried out for pH, TSM, Salinity, DO, BOD, dissolved phosphate, nitrate, ammonia and PHC	Water quality monitoring in sea water is being carried out regularly.
9	Inter-tidal region shall be analyzed for texture, phosphorous, chromium, nickel, copper, cadmium, lead, mercury and PHC	Noted and being complied with
10	Biological characteristics shall be assessed based on primary productivity, phytopigments, phytoplankton populations and their generic diversity, biomass, population and community diversity of benthos, fisheries composition and density as well as species diversity	Noted and being complied with
11	Regular (seasonal) monitoring of temperature at the outfall to take necessary mitigation measures. Online monitoring of salinity and temperature may be implemented	Is being complied
12	Shoreline evolution to be predicted by using Mathematical Model preferably `LITPACK of MIKE.21' due to the impact that may be caused by the piers constructed to carry intake and outfall pipelines	Noted and being complied with
13	Shoreline monitoring shall be carried out regularly by a reputed organization having requisite experience, in order to take up suitable preventive measures.	Noted and being complied with
14	The geographical position of the present HTL, LTL and slope of the beaches shall be maintained i.e. any erosion that may occur need to be prevented. The beach front shall be restored to the normal condition by adopting suitable engineering and vegetative measures	Noted and will be complied

VIMTA Labs Limited, Hyderabad

Sr. No.	Condition (Letter No: 245/Env/CZMA/2015, dated 05th June 2015)	Compliance Status
15	The Ash generated shall be utilized as per the norms stipulated in Fly Ash Notification dated 14-09-1999	Noted and being complied with
16	Environmental audit shall be taken up periodically by the independent agency and submit the report to the Regulatory Agencies	Noted and Form-V is being submitted

	Condition	
Sr. No.	(Consent Order No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06 th March 2020) for Unit – I & Unit – II	Compliance Status
	SCHEDULE-A	
1	Any up-set condition in any industrial plant / activity of the industry, which result in, increased effluent / emission discharge and/ or violation of standards stipulated in this order shall be informed to this Board, under intimation to the Collector and District Magistrate and take immediate action to bring down the discharge / emission below the limits.	Noted and shall be complied when such condition arises.
2	The industry should carryout analysis of waste water discharges or emissions through chimneys for the parameters mentioned in this order on quarterly basis and submit to the Board.	Noted and being complied with
3	All the rules & regulations notified by Ministry of Law and Justice, Government of India regarding Public Liability Insurance Act, 1991 should be followed as applicable	Public liability insurance is obtained
4	The industry should put up two sign boards (6x4 ft. each) at publicly visible places at the main gate indicating the products, effluent discharge standards, air emission standards, hazardous waste quantities and validity of CFO and exhibit the CFO order at a prominent place in the factory premises	Noted and being complied with
5	Notwithstanding anything contained in this consent order, the Board hereby reserves the right and powers to review / revoke any and/or all the conditions imposed herein above and to make such variations as deemed fit for the purpose of the Acts by the Board.	Noted
6	The applicant shall submit Environment statement in Form V before 30th September every year as per Rule No.14 of E(P) Rules, 1986 & amendments thereof	Noted and being complied with
7	The applicant should make applications through Online for renewal of Consent (under Water and Air Acts) and Authorization under HWM Rules at least 120 days before the date of expiry of this order, along with prescribed fee under Water and Air Acts and detailed compliance of CFO conditions for obtaining Consent & HW Authorization of the Board. The industry should immediately submit the revised application for consent to this Board in the event of any change in the raw material used, processes employed, quantity of trade effluents & quantity of emissions. Any change in the management shall be informed to the Board. The person authorized should not let out the premises / lend / sell / transfer their industrial premises without obtaining prior permission of the State Pollution Control Board.	Noted and being complied with
8	Any person aggrieved by an order made by the State Board under Section 25, Section 26, Section 27 of Water Act, 1974 or Section 21 of Air Act, 1981 may within thirty days from the date	Noted and being complied with
1/714	TA Labs Limited, Hyderabad	17

Sr.		Condition		
			Compliance Status	
No.		PPCB/VSP/VSP/19/HO/CFO		
	dated 06 th March 2020) for Unit – I & Unit – II on which the order is communicated to him, prefer an appeal as			
	per Andhra Pradesh Water Rules, 1976 and Air Rules 1982, to			
		ate authority constituted under		
		(Prevention and Control of Po		
		n 31 of the Air(Prevention and C		
	1981.			
9		dustry may explore the possibil	ity of tapping the solar	Will be reviewed.
5		for their energy requirement.		
		DULE – B		•
		R POLLUTION		
1		fluent discharged shall not contai	in constituents in excess	Noted and the effluent is Within the
_		tolerance limits mentioned below		prescribed limits
	Outlet		Limiting	
			Standards 6.50 — 8.50	
	1	pH Temperature-not more than 7°C hig		
		per MoEF Communication dated 20.04	4.1999.	
		Total Suspended Solids(at 103-105°		
		Oil and Grease Free chlorine	20 mg/I 0.5 mg/I	
		Phosphate as PO4	20 mg/I	
		Chromium (Total)	0.2 mg/I	
		Copper (Total)	1mg/I	
		Iron Zinc	1 mg/I 1 mg/I	
	2	рН	6.50 - 8.50	
		Oil and Grease	Oil and Grease 10 mg/l	
	BOD (3 days at 27 °C) 30 mg/l			
		Total Suspended Solids	<100 mg/I	
		Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml	<100 mg/I Jumber per<1000MPN /100 ml	
2	The in	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n	<100 mg/I Jumber per<1000MPN /100 ml	Noted and being complied with
2	The in	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml	<100 mg/I Jumber per<1000MPN /100 ml	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below:	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities</pre>	Noted and being complied with
2	The in	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr)</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption:	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoi	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r</pre>	Noted and being complied with
2	The in mentic	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoin From reservoir to UF/RO System	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoi	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoin From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30 80</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoin From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30 80 75 52</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoin From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required)	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 220 1600 180000 r 503 110 90 30 80 75 52 06</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From Pearlination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30 80 75 52 06</pre>	Noted and being complied with
2	The in mentic S.No Details	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From Desalination Plant to Reservoir From Peservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier UF , RO & EDI reject	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 220 1600 180000 r 503 110 90 30 80 75 52 06</pre>	Noted and being complied with
2	The in mentic S.No Details 4 A 4 A 1	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier UF, RO & EDI reject Water remain in recovery	<pre><100 mg/I Jumber per<1000MPN /100 ml ot exceed the quantities Quantity (m3/hr) 175580 2600 220 1600 180000 r 503 110 90 30 80 75 52 06 70 11</pre>	Noted and being complied with
2	The in mentic S.No Details of 4 A 4 A 1	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier UF, RO & EDI reject Water remain in recovery Ate meters with necessary pipe-I	<100 mg/I	Noted and being complied with
2	The in mentic S.No Details of 4 A 4 A 1	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From reservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier UF, RO & EDI reject Water remain in recovery	<100 mg/I	Noted and being complied with
2	The in mentic S.No Details of 4 A 4 A 1 Details of 4 A 4 A 1 Separa for as purpos	Total Suspended Solids Fecal Coliform (FC) (Most Probable N 100 milliliter, MPN/100ml dustry water consumption shall n oned below: Purpose Condenser & Auxiliary Cooling Water System Ash water sump Dust Suppression system For Desalination Plant feed Total of specific consumption: From Desalination Plant to Reservoir From Peservoir to UF/RO System RO Plant to Boiler Make Up, CPU Regeneration & other utilities Blow down Quenching Domestic Water HVAC & Ventilation Seal Water Service water APH & ESP Wash (As and when required) RO Plant to Clarifier UF, RO & EDI reject Water remain in recovery ate meters with necessary pipe-lassessing the quantity of water	<100 mg/I	Noted and being complied with

Chapter-2 Compliance Status Report

		Conditio		
Sr.	•			Compliance Status
No.			r Unit – I & Unit – II	
	of Sea water and maintain proper records for daily water			
	consumption and shall submit monthly reports to the RO, Visakhapatnam.			
4	water sumps by	31.03.2020.	at service water, domestic, ash	All water meters installed including Ash water meter.
5	flow meters measurements categories of wa	with totalizers for v for different streams	ers preferably Electro Magnetic vater and effluent quantity s of effluents and different n this order. The industry shall fluent	Noted and being complied with
6	The run-off wa		all be treated to on land for	Noted. Runoff water is being monitored.
7		nall discharge the cool	ing water into sea through a	Noted
8	The industry sh	all monitor all ground	water peizo wells and submit e months indicating trends	Noted and being complied
9	report to RO Visakhapatnam every three months indicating trends The industry shall maintain proper arrangements for collection of seepage from ash pond and pumped back into the ash water system, so as to avoid ground water pollution in the surrounding area.			Noted Toe drain was integral part of ash bund to collect the seepage and the same is pumped back to the ash water recovery system.
10	technologies su		effluents by adopting suitable aerated lagoons and discharge e irrigation/gardening.	Noted and being complied STP provided for treatment of domestic effluents
11	biocide will aff proximity of th designed outfall	ect the Biota of the e discharge point. It into the sea.	hrough system if treated with sea and fishing also, in the should be controlled properly	Noted and complied with.
	AIR POLLUTI			
1		shall not contain contain contain contain contain contain a contain a contain contain a contain contain contain	onstituents in excess of the	Noted.
	Chimney No.		Emission Standards	
	1	Particulate matter	50 mg/Nm3	
		S02	200 mg/Nm3	
		NOx	300 mg/Nm3	
		Mercury	0.03 mg/Nm3	
2	The industry s	shall comply with em	ission limits for DG sets of	Noted and being complied with.
	dated 01.07. Amendment R under the Env 2004. In case comply with e	ules, 2003 and G.S. ironment (Protection) of DG sets of capac mission limits as per 07.2002 at serial No	The DG sets are standby and used only in the absence of grid power supply.	
3	The industry s PM10 (Particul PM2.5 (Particul	hall comply with amb late Matter size less late Matter size less	tient air quality standards of than 10μ m) - 100μ g/m3; than 2.5 μ m)60 μ g/m3; SO2 side the factory premises at	Noted and being complied with
		ited Hyderabad		19

VIMTA Labs Limited, Hyderabad

	Condition	
Sr. No.	(Consent Order No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06 th March 2020) for Unit – I & Unit – II	Compliance Status
	the periphery of the industry. Standards for other parameters as mentioned in the National Ambient Air Quality Standards CPCB Notification No.B-29016/20/90/PCI-I, dated 18.11.2009 Noise Levels : Day time (6 AM to 10 PM) - 75 dB (A) Night time (10 PM to 6 AM) - 70 dB (A).	The Ambient air Quality and noise parameters with in the stipulated standards and reports are being submitted regularly
4	The industry shall provide interlocking facility between APC equipment (ESP) and fuel feeding system, in such a way that the feeding of the fuel shall be stopped automatically, in case, the ESP fails/ tripping's are occurred within 3 months.	Noted Alarm system of ESP fields is hooked up to main plant control room for taking immediate corrective measures.
5	The industry shall rectify CAAQM station at Coal Handling plant made in working condition by 10.04.2020.	Procurement process is in progress. Plant is under reserved shut down since July' 2020.
6	The industry shall maintain online Stack and ambient monitoring systems with connection to the Board's website	Online monitoring systems are available and Connected to board through online website.
7	The industry shall take necessary measures like Ammonia dosing to maintain ESPs attached to the Boilers so as to meet SPM standards all the time.	SPM standards are being complied with existing ESP design.
8	The industry maintain the data logging facility provided for storing online stack emission data properly, for retrieval as and when necessary. Industry shall submit monthly report to the RO Visakhapatnam	Real time data is being directly connected to APPCB website for online monitoring. Monthly Report being submitted to RO regularly to Visakhapatnam
	GENERAL:	
1	The industry shall not increase the capacity beyond the permitted capacity mentioned in this order.	Noted
2	The industry shall provide temperature indicator at marine out fall for assessing the temperature between the intake water and discharge water within three months.	Noted and being complied with Provided in discharge line.
3	The industry shall discharge off once through cooling effluents from Unit – $1 \& 2$ at a distance of 900 mts from the shoreline.	Noted and being complied with
4	The industry shall install permanent mechanical sprinklers for suppression of dust on the haul roads in between the villages and report the compliance to RO-Visakhapatnam	Complied. Mobile water tankers are being used for water sprinkling on roads.
5	The industry shall comply with CPCB directions dated 05.02.2014 / 02.03.2015 and guidelines issued regarding online monitoring systems issued from time to time. The online monitoring system shall be calibrated periodically as per equipment suppliers manual / CPCB guidelines	AAQ and Stack Emission of online monitoring systems are connected to APPCB and CPCB web site.
6	 The industry shall maintain the following records and the same shall be made available to the Board Officials during the inspection. Daily power generation details. Quantity of Effluents generated and disposed. Log Books for pollution control systems. Daily Fly ash generated and disposed. 	Noted and being complied with
7	The industry shall dispose fly ash to cement / brick units and export, excess to ash pond.	Pond ash and Fly ash will be utilized by the following Agencies:
		1) Simhadri Constructions.

	Condition	
Sr. No.	(Consent Order No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06 th March 2020) for Unit – I & Unit – II	Compliance Status
		plant is under reserved shutdown.
8	The industry shall submit detailed action plan for fly ash utilization as per the Fly Ash Notification on MoEF to the Board to achieve 100% utilisation of fly ash	Complied
9	The industry shall achieve 100 $\%$ of fly ash utilization within 3 months	Noted
10	The industry shall maintain water curtain in ash ponds as the fly ash is exposing to atmosphere and causing dust emissions during wind blow.	Noted and being complied with
11	The industry shall establish a dedicated Environmental cell for continuous monitoring of plant environment to ensure compliance of CFO conditions.	The Environment management is Dedicated Environment Management cell is in place to ensure compliance to CFO and EC Conditions.
12	Thick green belt shall be maintained by the industry covering an area of 33% of total area.	Presently green belt is being developed in and around the power project area in consultation with DFO and an area of 249.14 acres has already been developed. Further development of Green belt continuous.
13	The industry shall not exceed of emissions standards at any point of time. In case the industry exceeds the standards in the CEMS data, environmental compensation will be levied.	Noted
14	The industry shall treat the cooling waste waters to the marine coastal standards and the domestic waste waters to the on land for irrigation standards stipulated under Environmental (protection) Rules, 1986 as amended upto date, notified under Environment (Protection) Act,1986 by Ministry of Environment and Forest, Govt of India.	Noted
15	The industry shall maintain suitable control equipment facilities in the coal handling plant and dust suppression in all coal and material handling areas shall be achieved through appropriate methods.	Noted and being complied
16	The industry shall maintain duly compacted soil cover of requisite thickness as per norms for the ash ponds to avoid dust pollution and report the compliance to RO Visakhapatnam.	Noted
17	All the conditions/recommendations stipulated by A.P. Coastal Zone Management Authority vide letter No. 245/Env/CZMA/2015 dated 06.07.2015 shall be complied with.	Noted and being complied
18	All the conditions stipulated in the CRZ clearance granted by this Ministry vide letter No. 11-58/2011-IA-III dated 3rd January, 2014 and subsequent amendment dated 17th March, 2015 shall remain unchanged.	Noted and being complied
19	The PP shall use multi diffuser in the outfall. As suggested by NCSCM, the thermal water release shall be release at 10 m depth from the 8 diffuser.	Noted and being complied with
20	A monitoring system shall be deployed by the PP to assess the movement of thermal plume in and around the outfall coolant water jetty due to the occurrence of thermal plume oscillation in south- north direction during monsoon and also to monitor the impact of hot water discharge into the Sea and the flora and fauna. The PP shall	Noted and being complied with

	Condition	
Sr. No.	(Consent Order No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06 th March 2020) for Unit – I & Unit – II	Compliance Status
	comply with at the directions of APCZMA and take necessary corrective measures wherever required.	
21	The PP shall take all necessary clearance from the concerned authorities viz-a-viz from the concerned State Pollution Control Board.	Noted and being complied with
22	Care should be taken to ascertain minimal impact on the shoreline change due to construction of coastal structures. For this purpose, shoreline change shall be monitored using satellite imagery and by beach profile studies at regular intervals.	Noted and being complied with
23	The industry shall comply with the conditions stipulated in MoEF&CC,GoI amendment in CRZ Clearance Order dated 01.10.2015.	Noted and being complied with
24	The industry shall comply with the conditions stipulated in Amendment to the EC order dated 01.10.2015 regarding interim arrangement for the sea water intake and outfall system. SCHEDULE – C [see rule $6(2)$]	Noted and being complied with
	[CONDITIONS OF AUTHORISATION FOR OCCUPIER OR OPERATOR HANDLING	AZARDOUS WASTES]
1	The authorized person shall comply with the provisions of the Environment (Protection) Act, 1986, and the rules made there under.	Noted and being complied with
2	The authorisation shall be produced for inspection at the request of an officer authorised by the State Pollution Control Board.	Noted
3	The person authorised shall not rent, lend, sell, transfer or otherwise transport the hazardous and other wastes except what is permitted through this authorization.	
4	Any unauthorized change in personnel, equipment or working conditions as mentioned in the application by the person authorized shall constitute a breach of his authorization.	
5	The person authorised shall implement Emergency Response Procedure (ERP) for which this authorisation is being granted considering all site specific possible scenarios such as spillages, leakages, fire etc. and their possible impacts and also carry out mock drill in this regard at regular interval of time;	
6	The person authorized shall comply with the provisions outlined in the Central Pollution Control Board guidelines on "Implementing Liabilities for Environmental Damages due to Handling and Disposal of Hazardous Waste and Penalty".	
7	It is the duty of the authorised person to take prior permission of the State Pollution Control Board to close down the facility.	Noted
8	An application for the renewal of an authorization shall be made as laid down under these Rules.	Noted and being complied
9	Any other conditions for compliance as per the Guidelines issued by the Ministry of Environment, Forest and Climate Change or Central Pollution Control Board from time to time.	
10	Specific Conditions: Annual return shall be filed by June 30th for the period ensuring 31st	Noted and being complied
	March of the year.	
11	The industry shall comply with the provisions of HWM Rules, 2016 in terms of interstate transport of Hazardous Waste and manifest document prescribed Under Rule 18 and 19 of the HWM Rules, 2016.	
12	The industry shall not store hazardous waste for more than 90 days as per the Hazardous and Other Wastes (Management & Transboundary Movement) Rules, 2016.	
13	The industry shall store Used / Waste Oil and Used Lead Acid Batteries TA Labs Limited, Hyderabad	Noted and being complied 22

	Condition		
Sr.	(Consent Order	Compliance Status	
No.	No:APPCB/VSP/VSP/19/HO/CFO/2020, dated 06 th March 2020) for Unit – I & Unit – II		
	in a secured way in their premises till its disposal to the manufacturers / dealers on buyback basis.		
14	The industry shall transport the hazardous waste through vehicle fitted with GPS tracking system.	Noted and being complied	
15	The industry shall maintain 7 copy manifest system for transportation of waste generated and a copy shall be submitted to concerned Regional Office of APPCB. The driver who transports Hazardous Waste should be well acquainted about the procedure to be followed in case of an emergency during transit. The transporter should carry a Transport Emergency (TREM) Card.		
16	The industry shall maintain proper records for Hazardous and Other Wastes stated in Authorisation in Form-3 i.e., quantity of Incinerable waste, land disposal waste, recyclable waste etc., and file annual returns in Form-4 as per Rule 20 (2) of the Hazardous and Other Wastes (Management & Transboundary Movement) Rules, 2016.		



Chapter-3 Baseline Environmental Status

3.0 BASELINE ENVIRONMENTAL STATUS

3.1 Meteorology

Micro - Meteorological data within the project area during the air quality survey period is an indispensable part of the air pollution study. A meteorological station was installed on the top of Plant Security office, which is about 10 m height from the ground level in plant site free from obstructions to free flow of winds.

Wind speed and Wind direction data recorded during the study period are useful for the calculation of relative percentage frequencies of different wind directions and are plotted as wind roses of sixteen directions Viz. N, NNE, NE, ENE, E, ESE, SE, SSE, S, SSW, SW, WSW, W, WNW, NW and NNW for twenty-four hours' duration respectively.

Maximum and Minimum temperatures including the percentage relative humidity were also recorded simultaneously.

3.1.1 <u>Wind Pattern during April - September 2021</u>

The area is marked by high wind speeds in the range of calm to 19 KMPH winds. During the 00-24 hrs, the predominant wind directions were from SW (26.5%), WSW (24.3%), SSW (12.0%), W (7.6%) and S (4.4.0%) of the total time. The calm conditions prevailed for 11.6% of the total time. The winds prevailed for 13.6% of the total time in other directions. The average wind rose for the study period is shown in **Figure-3.1**.

• Temperature and Relative Humidity Levels during April - September 2021

Maximum and minimum temperatures recorded during the study period were 41.5 and 21.4°C respectively. Maximum and minimum relative humidity recorded during the study period was 99 and 21 % respectively. Rainfall was observed during the study period is about 607.2 mm which is given in **Table-3.1**.

Sr.	Parameters	April - September 2021		
No		Min	Max	
1	Temperature (°C)	21.4	41.5	
2	Relative humidity (%)	21	99	
63	Atmospheric Pressure (mb)	997.2	1008.2	
4	Rainfall (mm)	607.2		

TABLE-3.1 METEOROLOGICAL DATA GENERATED AT PROJECT SITE

Chapter-3 Baseline Environmental Status

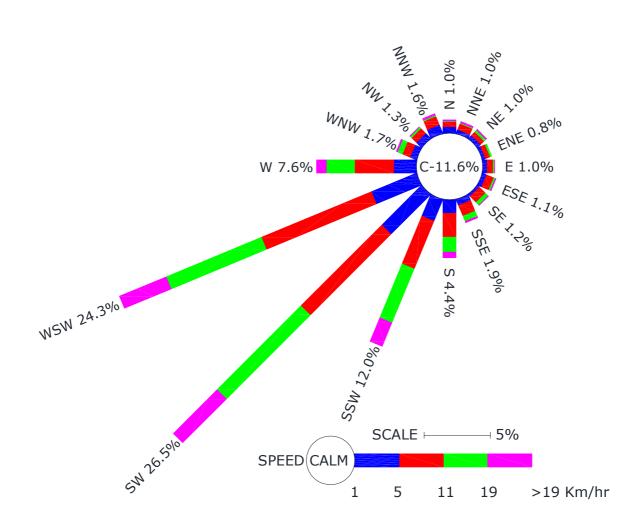


FIGURE-3.1 WINDROSE FOR APRIL TO SEPTEMBER 2021

Chapter-3 Baseline Environmental Status

3.2 Ambient Air Quality

Dispersion of different air pollutants released into the atmosphere has significant impacts on neighborhood air environment of an industrial project. The existing ambient air quality status with respect to the study zone of 10 km radial distance from the plant site has been assessed through a monitoring network of 8 AAQ stations during the **April - September 2021.**

The design of monitoring network in the air quality surveillance programme has been based on the GLC's obtained using long term screening model considering the following:

- (i) Meteorological conditions on synoptic scale;
- (ii) Topography of the study area;
- (iii)Representation of regional background levels;
- (iv)Representation of plant site; and
- (v) Representation of cross sectional distribution in the downward direction.

The existing status of Air environment was monitored for PM2.5, PM10, and gaseous pollutants like Sulphur dioxide (SO₂), Nitrogen dioxide (NO2) and Carbon monoxide (CO), Ammonia (NH₃), Ozone (O₃), Benzene (C₆H₆) and metals like Benzo(a)pyrene, Lead (Pb), Arsenic (As) and Nickel (Ni).

Ambient Air Quality Monitoring (AAQM) stations were set up at 8 locations with due consideration to the above mentioned points. **Table-3.2** gives the details of environmental setting around each monitoring station. The location of the selected stations with reference to the plant site is given in the same table and depicted in **Figure-3.2**.

3.2.1 Frequency and Parameters for Sampling

The following frequency has been adopted for sampling:

Ambient air quality monitoring has been carried out with a frequency of 2 days per week at 8 locations. (April - September 2021).

The Post monitoring of air environment is generated for the following parameters:

- Fine Respirable Particulate Matter (PM2.5);
- Respirable Particulate Matter (PM10);
- Sulphur dioxide (SO₂);
- Nitrogen dioxide (NO₂);
- Carbon Monoxide (CO);
- Ammonia (NH₃);
- Ozone (O₃);
- Benzene (C₆H₆);
- Benzo(a)pyrene;
- Lead (Pb);
- Arsenic (As) and
- Nickel (Ni).

Chapter-3 Baseline Environmental Status

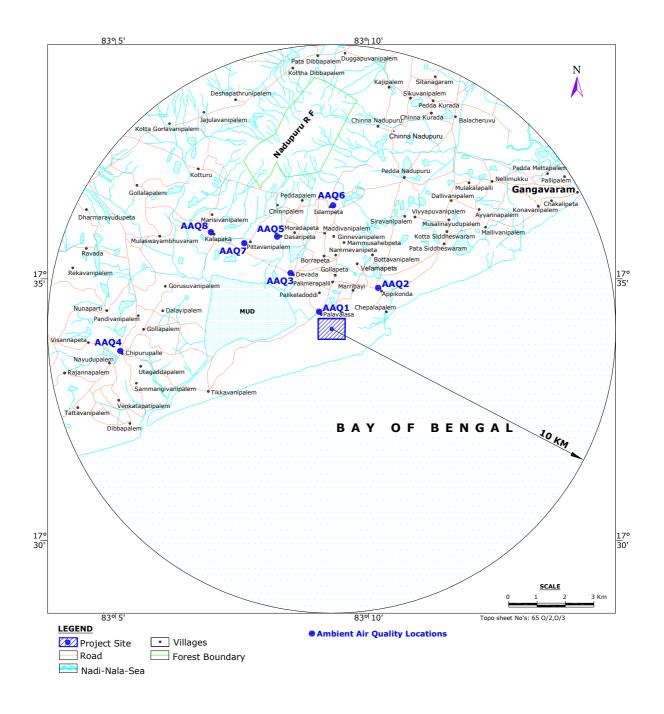


FIGURE-3.2 AIR QUALITY SAMPLING LOCATIONS

Chapter-3 Baseline Environmental Status

Station Code	Name of the Station	Distance w.r.t. site (km)	Direction w.r.t. site	Environmental Setting
AAQ1	Palavalasa	0.5	N	Rural/Residential activities
AAQ2	Appikonda	2.2	NE	Rural/Residential activities
AAQ3	Devada	2.3	NW	Rural/Residential activities
AAQ4	Cheepurupalli	7.4	W	Rural/Residential activities
AAQ5	Dasaripeta	3.7	NNW	Rural/Residential activities
AAQ6	Islampeta	4.3	N	Rural/Residential activities.
AAQ7	Pittavanipalem	4.2	NW	Rural/Residential activities
AAQ8	Kalapaka	5.3	NW	Rural/Residential activities

TABLE-3.2 DETAILS OF AMBIENT AIR QUALITY MONITORING LOCATIONS

3.2.2 Duration of Sampling

The sampling duration for Particulate Matter PM2.5, PM10, SO_2 , NO2, Ammonia, Benzo(a)Pyrene, Benzene, Arsenic, Nockel and Lead is twenty four hourly continuous sample per day and CO and Ozone is sampled for 8 hours continues thrice a day. This is to allow a comparison with the present revised standards mentioned in the latest Gazette notification of the Central Pollution Control Board (CPCB).

3.2.3 Method of Analysis

The air samples were analyzed as per standard methods specified by Central Pollution Control Board (CPCB) (16th November, 2009); IS: 5182 and American Public Health Association (APHA).

3.2.4 Details of the Sampling Locations

AAQ1: PALAVALASA

The monitoring station was installed on top of a residential building at a height of 4.5 m from ground level at a distance of 0.5 km in the N direction from the proposed plant site. This station was selected to assess the air quality levels in the crosswind direction. This location is situated within rural/residential activities.

AAQ2: APPIKONDA

The monitoring station was installed on top of a residential building at a height of 5.0 m from ground level at a distance of 2.2 km in the NE direction from the plant site. This station was selected to assess the air quality levels in the Down wind direction. This location is situated within rural/residential activities.

AAQ3: DEVADA

The monitoring station was installed on top of a residential building at a height of 4 m from ground level at a distance of 2.3 km in the North West direction from the

Chapter-3 Baseline Environmental Status

plant site. This station was selected to assess the air quality levels in the crosswind direction. This location is situated within rural/residential activities.

AAQ4: CHEEPURUPALLE

The location has been finalized to assess the air quality levels in the Up wind direction to the proposed plant site. The monitoring station is located at a distance of about 7.4 km west of the proposed plant site. The sampler is installed on a residential building at a height of about 4.5 m from ground level. Rural residential activities surround the station.

AAQ5: DASARIPETA

The sampling station has been finalized to assess the air quality levels in the crosswind direction to the proposed plant site. The monitoring station is located NNW of the plant site at about 3.7 km. The sampler was installed on top of residential building at a height of about 5.0 m from ground level free from any obstructions. This location is situated in rural/residential activities with village activities.

AAQ6: ISLAMPETA

The monitoring station was installed on top of a residential building at a height of 4.5 m from ground level at a distance of 4.3 km in the N direction from the plant site. This station was selected to assess the air quality levels in the crosswind direction. This location is situated within rural/residential activities.

AAQ7: PITTAVANIPALEM

The location has been finalized to assess the air quality levels in the downwind direction to the proposed plant site. The monitoring station is located at a distance of about 4.2 km North West of the proposed plant site. The sampler is installed on a residential building at a height of about 6.0 m from ground level. Rural residential activities surround the station.

AAQ8: KALAPAKA

At this monitoring station the sampler was installed on top of a residential building at a height of 5.0 m from ground level at a distance of 5.3 km in the NW direction from the proposed plant site. This station was selected to assess the air quality levels in the cross wind direction. This location is situated within rural/residential activities.

3.2.5 <u>Selection of Instruments for Air Quality Sampling</u>

Respirable Dust Samplers of Envirotech instruments are being used for monitoring Respirable Particulate Matter (PM10), Respirable fraction (<10 microns), Fine Respirable Particulate Matter (PM2.5), Respirable fraction (<2.5 microns), and gaseous pollutants like SO_2 and NO2. Gas Chromatography techniques have been used for the estimation of CO.

Chapter-3 Baseline Environmental Status

3.2.6 Sampling and Analytical Techniques

1] <u>Fine Respirable Particulate matter (PM2.5) and Respirable Particulate matter</u> (PM10)

Fine Respirable Particulate Matter – FRPM (PM2.5) and particles below 10 μ (PM10), which are more likely Respirable (Respirable Particulate matter – RPM). RPM Present in ambient air is measured by Gravemetric method by using Respirable Dust Sampler with a cyclone attachment over a period of 24 hours by sucking known quantity of air through Glass micro fibre filter paper and PM2.5 by Teflon filter paper. Respirable Dust (<10 μ) is computed by measuring weight of collected matter in known volume of air sampled (BIS:5182 part IV, 1973; ASTM D-4096 -91).

2] <u>Sulphur Dioxide</u>

The most commonly used method for measuring atmospheric SO_2 is based on colorimetry and is known as modified West - Gaeke method. In this method SO_2 from a measured quantity of air is absorbed in a solution of sodium tetrachloromercurate to form a stable and non-volatile dichlorosulphitomercurate complex. This is then reacted with formaldehyde and bleached pararosaniline, yielding magenta - coloured pararosaniline methyl sulfonic acid. The colour intensity of this acid is detected photometrically at 560 nm (A.P.H.A and BIS: 5182 Part-II, 1969).

3] <u>Nitrogen Dioxide</u>

Concentration of nitrogen dioxide is estimated in ambient air by using Jacob and Hochheiser method. Nitrogen dioxide are collected by bubbling air through a sodium hydroxide solution to form a stable solution of sodium nitrite. The nitrite ion produced during sampling is determined colorimetrically by reacting the exposed absorbing reagent with phosphoric acid, sulfanilamide, and NEDA (1-naphthyl ethylenediamine dihydrochloride) at 540 nm (BIS: 5182 Part-VI, 1975).

4] <u>Carbon Monoxide</u>

A sample of the air containing carbon monoxide is adsorbed on Charcoal plugged into a glass tube. The adsorbed charcoal is eluted using the solvent, which in turn is projected into the gas chromatograph where it is carried from one end of the column to the other. During its movement, the constituents of the sample undergo distribution at different rates and ultimately get separated from one another. The separated constituents emerge from the end of the column one after the other and are detected by suitable means whose response is related to the amount of a specific component leaving the column [CO- IS: 5182 (Part-X)].

The details of the methods used for monitoring studies are presented in **Table-3.3.**

Chapter-3 Baseline Environmental Status

TABLE-3.3 TECHNIQUES USED FOR AMBIENT AIR QUALITY MONITORING

Sr.	Parameter	Method of Mesuarement
No.		
1	Fine Respirable Particulate Matter	Respirable Dust Sampler (Gravimetric method)
2	Respirable Particulate Matter	Respirable Dust Sampler (Gravimetric method)
3	Sulphur Dioxide	Improved West and Gaeke method
4	Nitrogen Oxide	Modified Jacob & Hochheiser method
5	Carbon Monoxide	NDIR (Non Dispersive Infrared Spectroscopy)
6	Ammonia (NH ₃)	Indophenol Blue method
7	Ozone (O ₃)	Spectrophotometric method
8	Benzene (C_6H_6)	Gas Chromatography
9	Benzo(a)pyrene	Solvent extraction followed by GC MS
10	Lead (Pb)	AAS / ICP-MS method
11	Arsenic (As)	AAS / ICP-MS method
12	Nickel (Ni)	AAS / ICP-MS method

3.2.7 Presentation of Primary Data

a) Observations of Primary Data – April to September 2021

Various statistical parameters like 98th percentile, average, maximum and minimum values have been computed from the observed raw data for all the AAQ monitoring stations.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ1) Palavalasa village

The maximum concentration for PM2.5 is recorded as 25.1 μ g/m³ with minimum concentration as 19.7 μ g/m³. The 98th percentile values are observed as 25.1 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 58.8 μ g/m³ with minimum concentration as 44.3 μ g/m³. The 98th percentile values are observed as 56.4 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.1 μ g/m³ with minimum concentration as 9.4 μ g/m³. The 98th percentile values are observed as 12.9 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.1 μ g/m3 with minimum concentration as 11.1 μ g/m³. The 98th percentile values are observed as 15.0 μ g/m³ respectively.

The maximum CO concentration is recorded as 278 $\mu g/m3$ with minimum concentration as 182 $\mu g/m^3$. The 98th percentile values are observed as 267 $\mu g/m^3$ respectively.

Chapter-3 Baseline Environmental Status

The maximum O_3 concentration is recorded as 7.9 μ g/m3 with minimum concentration as 4.0 μ g/m³. The 98th percentile values are observed as 7.4 μ g/m³ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ2) Appikonda village

The maximum concentration for PM2.5 is recorded as 27.1 μ g/m³ with minimum concentration at 20.0 μ g/m³. The 98th percentile values are observed as 26.7 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 54.8 μ g/m³ with minimum concentration as 43.2 μ g/m³. The 98th percentile values are observed as 54.6 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 9.4 μ g/m³ with minimum concentration as 13.0 μ g/m³. The 98th percentile values are observed as 12.6 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.1 μ g/m³ with minimum concentration as 11.6 μ g/m³. The 98th percentile values are observed as 14.6 μ g/m³ respectively.

The maximum CO concentration is recorded as 284 $\mu g/m3$ with minimum concentration as 188 $\mu g/m^3$. The 98th percentile values are observed as 283 $\mu g/m^3$ respectively.

The maximum O_3 concentration is recorded as 8.2 $\mu g/m3$ with minimum concentration as 4.2 $\mu g/m^3$. The 98th percentile values are observed as 7.4 $\mu g/m^3$ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ3) Devada villag5

The maximum concentration for PM2.5 is recorded as 25.5 μ g/m³ with minimum concentration as 19.5 μ g/m³. The 98th percentile values are observed as 25.0 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 54.7 μ g/m³ with minimum concentration as 43.6 μ g/m³. The 98th percentile values are observed as 53.9 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.7 μ g/m³ with minimum concentration as 9.6 μ g/m³. The 98th percentile values are observed as 13.3 μ g/m³ respectively.

Chapter-3 Baseline Environmental Status

The maximum NO₂ concentration is recorded as 15.2 μ g/m³ with minimum concentration as 12.1 μ g/m³. The 98th percentile values are observed as 15.2 μ g/m³ respectively.

The maximum CO concentration is recorded as 229 $\mu g/m3$ with minimum concentration as 190 $\mu g/m^3$. The 98th percentile values are observed as 259 $\mu g/m^3$ respectively.

The maximum O₃ concentration is recorded as 7.3 $\mu g/m3$ with minimum concentration as 4.2 $\mu g/m^3$. The 98th percentile values are observed as 7.1 $\mu g/m^3$ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ4) Cheepurupalle village

The maximum concentration for PM2.5 is recorded as 26.8 μ g/m³ with minimum concentration as 19.4 μ g/m³. The 98th percentile values are observed as 26.4 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 59.4 μ g/m³ with minimum concentration as 45.8 μ g/m³. The 98th percentile values are observed as 58.2 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 14.2 $\mu g/m^3$ with minimum concentration as 9.7 $\mu g/m^3$. The 98th percentile values are observed as 14.2 $\mu g/m^3$ respectively.

The maximum NO₂ concentration is recorded as 16.3 μ g/m³ with minimum concentration as 10.9 μ g/m³. The 98th percentile values are observed as 16.2 μ g/m³ respectively.

The maximum CO concentration is recorded as 288 $\mu g/m3$ with minimum concentration as 182 $\mu g/m^3$. The 98th percentile values are observed as 279 $\mu g/m^3$ respectively.

The maximum O_3 concentration is recorded as 8.7 $\mu g/m3$ with minimum concentration as 4.2 $\mu g/m^3$. The 98th percentile values are observed as 8.0 $\mu g/m^3$ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ5) Dasaripeta village

The maximum concentration for PM2.5 is recorded as 25.2 μ g/m³ with minimum concentration as 19.6 μ g /m³. The 98th percentile values are observed as 25.1 μ g/m³ respectively.

Chapter-3 Baseline Environmental Status

The maximum concentration for PM10 is recorded as 53.1 μ g/m³ with minimum concentration as 44.7 μ g/m³. The 98th percentile values are observed as 52.9 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.1 μ g/m³ with minimum concentration as 10.1 μ g/m³. The 98th percentile values are observed as 12.9 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.0 μ g/m³ with minimum concentration as 12.1 μ g/m³. The 98th percentile values are observed as 14.7 μ g/m³ respectively.

The maximum CO concentration is recorded as 268 $\mu g/m3$ with minimum concentration as 191 $\mu g/m^3.$ The 98th percentile values are observed as 263 $\mu g/m^3$ respectivel

The maximum O_3 concentration is recorded as 7.7 μ g/m3 with minimum concentration as 4.21μ g/m³. The 98th percentile values are observed as 7.1 μ g/m³ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ6) Islampeta village

The maximum concentration for PM2.5 is recorded as 25.6 μ g/m³ with minimum concentration as 19.5 μ g/m³. The 98th percentile values are observed as 25.4 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 53.8 μ g/m³ with minimum concentration as 45.2 μ g/m³. The 98th percentile values are observed as 53.4 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.1 μ g/m³ with minimum concentration as 9.0 μ g/m³. The 98th percentile values are observed as 12.5 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.6 μ g/m³ with minimum concentration as 11.2 μ g/m³. The 98th percentile values are observed as 15.5 μ g/m³ respectively.

The maximum CO concentration is recorded as 245 $\mu g/m3$ with minimum concentration as 179 $\mu g/m^3$. The 98th percentile values are observed as 244 $\mu g/m^3$ respectively.

The maximum O_3 concentration is recorded as 7.1 µg/m3 with minimum concentration as 4.0 µg/m³. The 98th percentile values are observed as 6.7 µg/m³ respectively.

Chapter-3 Baseline Environmental Status

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ7) Pittavanipalem village

The maximum concentration for PM2.5 is recorded as 27.3 μ g/m³ with minimum concentration as 20.5 μ g/m³. The 98th percentile values are observed as 27.0 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 63.2 μ g/m³ with minimum concentration as 46.3 μ g/m³. The 98th percentile values are observed as 62.3 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.8 μ g/m³ with minimum concentration as 10.1 μ g/m³. The 98th percentile values are observed as 13.7 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.9 μ g/m³ with minimum concentration as 12.3 μ g/m³. The 98th percentile values are observed as 15.5 μ g/m³ respectively.

The maximum CO concentration is recorded as 271 μ g/m3 with minimum concentration as 194 μ g/m³. The 98th percentile values are observed as 267 μ g/m³ respectively.

The maximum O_3 concentration is recorded as 8.0 $\mu g/m3$ with minimum concentration as 4.2 $\mu g/m^3$. The 98th percentile values are observed as 7.4 $\mu g/m^3$ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

AAQ8) Kalapaka village

The maximum concentration for PM2.5 is recorded as 25.5 μ g/m³ with minimum concentration as 19.0 μ g/m³. The 98th percentile values are observed as 25.1 μ g/m³ respectively.

The maximum concentration for PM10 is recorded as 56.2 μ g/m³ with minimum concentration as 44.6 μ g/m³. The 98th percentile values are observed as 55.3 μ g/m³ respectively.

The maximum SO₂ concentration is recorded as 13.0 μ g/m³ with minimum concentration as 10.2 μ g/m³. The 98th percentile values are observed as 12.9 μ g/m³ respectively.

The maximum NO₂ concentration is recorded as 15.2 μ g/m³ with minimum concentration as 12.1 μ g/m³. The 98th percentile values are observed as 15.2 μ g/m³ respectively.

Chapter-3 Baseline Environmental Status

The maximum CO concentration is recorded as 263 μ g/m3 with minimum concentration as 191 μ g/m³. The 98th percentile values are observed as 261 μ g/m³ respectively.

The maximum O_3 concentration is recorded as 7.4 $\mu g/m3$ with minimum concentration as 4.0 $\mu g/m^3.$ The 98th percentile values are observed as 7.2 $\mu g/m^3$ respectively.

The concentration of NH3, Pb, As, Ni, B(a)P and C6H6 values are well within the detectable limits.

3.2.8 Regional Scenario

The ambient air quality survey was carried out for **April to September 2021** at eight locations in the 10 Km radial distance. The monitoring was carried out for Fine Respirable Particulate Matter (PM2.5), Respirable Particulate Matter (PM10), Sulphur dioxide (SO₂), Nitrogen dioxide (NO₂) and Carbon monoxide (CO), Ammonia (NH₃), Ozone (O₃), Benzene (C₆H₆) and metals like Benzo(a)pyrene, Lead (Pb), Arsenic (As) and Nickel (Ni). The results of monitoring carried out during study period are presented in **Annexure-II** for **April to September 2021**.

Various statistical parameters like Maximum, Minimum, Average and 98th percentile have been computed from the observed raw data for all sampling stations. The ambient air quality Summary of concentrations of different parameters (PM2.5, PM10, SO₂, NO₂, CO, NH3, O3, C6H6, B(a)P, As, Ni and Pb is presented in **Tables 3.4 and 3.5**

The AAQ levels observed at all the sampling locations were within the limits specified by CPCB for Industrial/Mixed use and Residential/Rural use.

TABLE - 3.4 SUMMARY OF AMBIENT AIR QUALITY DATA (APRIL TO SEPTEMBER 2021)

Looption			PM2	2.5			РМ	110			SO	2	
Location Code	Location	Min	Max	Avg	98% Tile	Min	Max	Avg	98% tile	Min	Max	Avg	98% tile
AAQ1	Palavalasa village	19.7	25.1	22.6	25.1	44.5	58.8	50.7	56.4	9.4	13.1	11.2	12.9
AAQ2	Appikonda village	20.0	27.1	23.5	26.7	43.2	54.8	49.7	54.6	9.4	13.0	11.1	12.6
AAQ3	Devada village	19.5	25.5	22.6	25.0	43.6	54.7	48.3	53.9	9.6	13.7	11.6	13.3
AAQ4	Cheepurupalle village	19.4	26.8	23.1	26.4	45.8	59.4	51.7	58.2	9.7	14.2	11.8	14.2
AAQ5	Dasaripeta village	19.6	25.2	22.5	25.1	44.7	53.1	48.7	52.9	10.1	13.1	11.3	12.9
AAQ6	Islampeta village	19.5	25.6	22.7	25.4	45.2	53.8	49.0	53.4	9.0	13.1	11.2	12.5
AAQ7	Pittavanipalem village	20.5	27.3	24.2	27.0	46.3	63.2	54.6	62.3	10.1	13.8	11.8	13.7
AAQ8	Kalapaka village	19.0	25.5	22.4	25.1	44.6	56.2	50.5	55.3	10.2	13.0	11.5	12.9

Location			NC) ₂			C	0			03	8	
Code	Location	Min	Max	Avg	98% Tile	Min	Max	Avg	98% tile	Min	Max	Avg	98% Tile
AAQ1	Palavalasa village	11.1	15.1	13.3	15.0	182	278	224	267	4.0	7.9	5.5	7.4
AAQ2	Appikonda village	11.6	15.1	13.1	14.6	188	284	238	283	4.2	8.2	5.8	7.4
AAQ3	Devada village	12.1	15.2	13.7	15.2	190	262	229	259	4.2	7.3	5.7	7.1
AAQ4	Cheepurupalle village	10.9	16.3	13.7	16.2	182	288	229	279	4.2	8.7	6.2	8.0
AAQ5	Dasaripeta village	12.1	15.0	13.5	14.7	191	268	233	267	4.2	7.7	5.6	7.1
AAQ6	Islampeta village	11.2	15.6	13.5	15.5	179	245	214	244	4.0	7.1	5.4	6.7
AAQ7	Pittavanipalem village	12.3	15.9	13.9	15.5	194	271	238	267	4.2	8.0	5.9	7.4
AAQ8	Kalapaka village	12.1	15.2	13.7	15.2	191	263	229	261	4.0	7.4	5.7	7.2

*Note: (Concentrations are expressed in $\mu g / m^3$)

Chapter-3 Baseline Environmental Status

TABLE - 3.5SUMMARY OF AMBIENT AIR QUALITY DATA (APRIL TO SEPTEMBER 2021)

Location			NH	3			Р	b		As				
Location Code	Location	Min	Max	Avg	98% tile	Min	Max	Avg	98% tile	Min	Max	Avg	98% tile	
AAQ1	Palavalasa village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ2	Appikonda village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ3	Devada village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ4	Cheepurupalle village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ5	Dasaripeta village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ6	Islampeta village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ7	Pittavanipalem village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	< 0.001	<1.0	<1.0	<1.0	<1.0	
AAQ8	Kalapaka village	<20	<20	<20	<20	< 0.001	< 0.001	<0.001	<0.001	<1.0	<1.0	<1.0	<1.0	

Location			Ν	li			B(3	a)P			C6H	6	
Code	Location	Min	Max	Avg	98% tile	Min	Max	Avg	98% tile	Min	Max	Avg	98% tile
AAQ1	Palavalasa village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	< 0.1	1.0	1.0	1.0	1.0
AAQ2	Appikonda village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ3	Devada village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ4	Cheepurupalle village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ5	Dasaripeta village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ6	Islampeta village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ7	Pittavanipalem village	<1.0	<1.0	<1.0	<1.0	<0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0
AAQ8	Kalapaka village	<1.0	<1.0	<1.0	<1.0	< 0.1	< 0.1	<0.1	<0.1	1.0	1.0	1.0	1.0

*Note: (Concentrations are expressed in $\mu g / m^3$ except As, Ni and B(a)p are ng $/ m^3$)

Chapter-3 Baseline Environmental Status

3.3 Fugitive Dust Emission Monitoring

Fugitive dust emission monitoring has been carried out eight hours monitoring during the **April to September 2021**. The monitoring has been carried out in five locations. The analysis results of fugitive dust monitoring are represented in **Table-3.6**.

TABLE-3.6 FUGITIVE DUST MONITORING RESULTS

					Al	l values are	in (μg/m³)
Sr.No	Location Name	Apr 2021	May 2021	Jun 2021	Jul 2021	Aug 2021	Sep 2021
1	Plant Main gate						
2	Power Plant service building						
3	Coal handling plant			Plar	nt Shutdow	'n	
4	Work shop building						
5	Ash handling plant						

3.4 Ambient Noise Quality

Eight locations were monitored for ambient noise levels within the 10-km radius of the Thermal power plant and three locations for Inside the Plant. The monitoring will be carried out every month and details of presented in **Table-3.7** and are shown in **Figure-3.3**.

TABLE-3.7 AMBIENT NOISE MONITORING LOCATIONS

Sampling Code	Name of the Location	Direction w.r.t to Plant
N1	Palavalasa village	N
N2	Appikonda village	NE
N3	Devada village	NW
N4	Cheepurapalli village	W
N5	Dasaripeta village	NNW
N6	Islampeta village	N
N7	Pittavanipalem village	NW
N8	Kalapaka village	NW
	Inside the Plant Area	
N9	Near HNPCL Office	-
N10	Near Boiler Area	-
N11	Near Power Mech Stores	-

Sound Pressure Level (SPL) measurements were measured by noise meter at all the above locations. Noise level monitoring was carried continuously for 24-hours with one hour interval. During each hour parameters like L10, L50, L90, Leq, Lday and Lnight were directly computed by the instrument based on the sound pressure levels. The day noise levels have been monitored during 6 am to 10 pm and night levels during 10 pm to 6 am.

Chapter-3 Baseline Environmental Status

3.4.1 Noise Quality

Noise levels were measured in 8 villages and 1 inside the plant area for 24 hours and 2 locations in plant site for source noise levels on monthly basis and the measured noise levels in day time and night time from **April to September 2021** are given below in **Table-3.8 and 3.9.** The noise levels are well within the CPCB norms for Rural Residential zones.

TABLE-3.8 AMBIENT NOISE LEVEL MONITORING RESULTS (APRIL TO SEPTEMBER 2021)

S.No	Sources	April 2021		May 2021		June 2021		July 2021		August 2021		September 2021	
		Day	Night	Day	Night	Day	Night	Day	Night	Day	Night	Day	Night
1	Palavalasa	46.1	42.5	44.2	40.6	46.0	42.4	45.1	41.5	46.7	43.1	47.1	43.5
2	Appikonda	44.6	41.0	45.3	41.7	44.7	41.1	43.7	40.1	44.4	40.8	46.2	42.6
3	Devada	46.1	42.5	44.8	41.2	45.2	41.6	46.0	42.4	45.0	41.4	44.8	41.2
4	Cheepurupalle	45.8	42.2	46.6	43.0	47.1	43.5	46.7	43.1	45.8	42.2	46.7	43.1
5	Dasaripeta	46.1	42.5	45.7	42.1	44.8	41.2	44.9	41.3	44.3	40.7	46.9	43.3
6	Islampeta	44.4	40.8	46.2	42.6	45.4	41.8	44.4	40.8	45.1	41.5	46.3	42.7
7	Pittavanipalem	45.9	42.3	47.6	44.0	46.2	42.6	45.6	42.0	46.6	43.0	44.5	40.9
8	Kalapaka	45.2	41.6	46.0	42.4	44.9	41.3	44.2	40.6	45.4	41.8	46.0	42.4
C	PCB Limits	55	45	55	45	55	45	55	45	55	45	55	45

TABLE-3.9 NOISE LEVEL MONITORING RESULTS INSIDE THE PLANT (APRIL TO SEPTEMBER 2021)

S.No	Sources	April May 2021 2021				June 2021		July 2021		August 2021		September 2021	
		Day	y Night D		Night	Day	Night	Day Night		Day	Night	Day	Night
1	Near Plant main gate	-			-	-	-	-			52.3	56.8	53.2
	CPCB Limits	75	75	70	75	70	75	70	75	70	75	70	70
2	Near Boiler area						Diant (Shutdov	un l				
3	3 Near Turbine area						FidIIUS	Shutdov	VII				
	CPCB Limits	9	90		90	9	90	9	9 0	9) 0	9	0

Chapter-3 Baseline Environmental Status

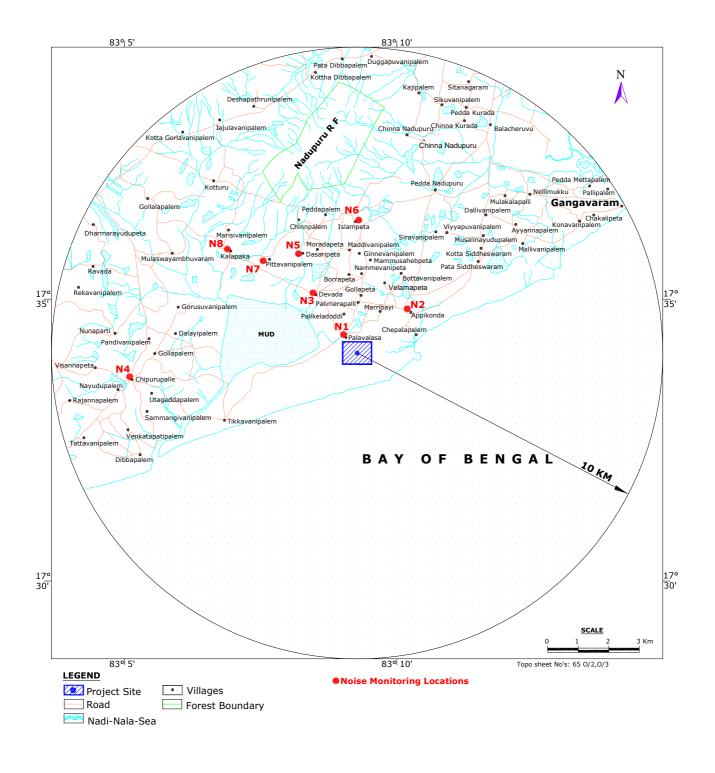


FIGURE-3.3 NOISE MONITORING LOCATIONS

Chapter-3 Baseline Environmental Status

3.5 WATER QUALITY

Water quality of ground water samples is collected to assess the quality of water with in the 10Km radius. Water samples were collected from six Ground water locations and four Surface water locations.

These samples were taken as grab samples and preservation and transportation of the samples are done as per the standard sampling procedures and analyzed in laboratory. The details of the sampling locations are given below in **TABLE-3.10** and shown in **Figure-3.4**

Sampling Code	Name of the Location	Direction w.r.t to Plant
I	Ground Water Samples	
GW1	Devada village	NW
GW2	Islampeta village	Ν
GW3	Velama Appikonda village	NNE
GW4	Dasaripeta village	NNW
GW5	Palavalasa village	Ν
GW6	Rajiv Nagar	NE
GW7	Gouruvanipalem village	Ν
III	Creek Water Samples	
SW1	At Vade cheepurapalli	WSW
II	Surface water Samples (Marine Water)	
SW2	Appikonda beach	ENE
SW3	Tikavanipalem beach	SW
III	Waste Water Samples	
SW4	ETP Outlet	-
SW5	Outfall water at diffusion point	SE

TABLE-3.10 WATER QUALITY SAMPLING LOCATIONS

The details of the Water Quality Analysis of (April to September 2021) are given below in Table-3.11 to Table-3.19.

Chapter-3 Baseline Environmental Status

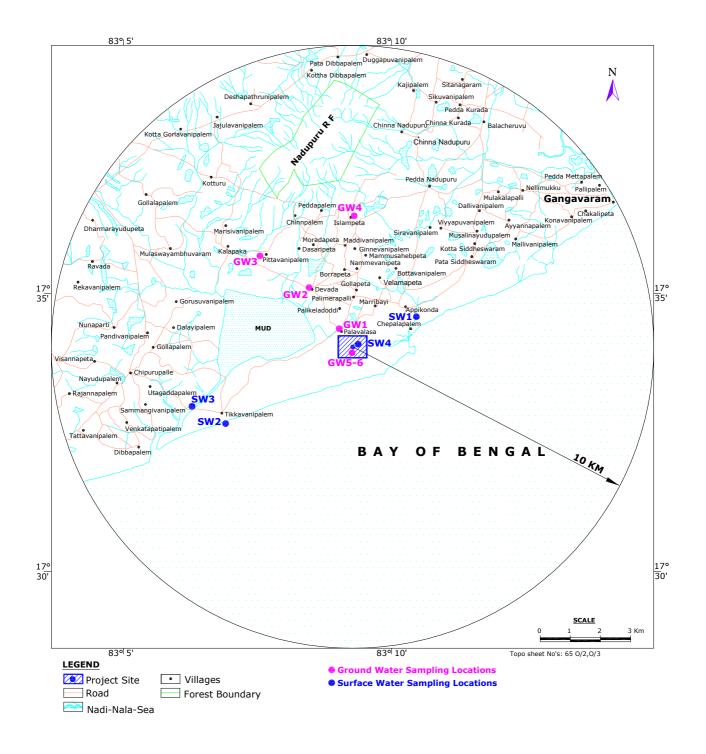


FIGURE-3.4 WATER SAMPLING LOCATIONS

Chapter-3 Baseline Environmental Status

TABLE-3.11 GROUND WATER QUALITY

Sr.N	Parameters	Unit			GW1 - Dev	ada village			Limits as per IS:10500
0.			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	рН	-	7.6	7.5	7.7	7.5	7.8	7.17	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1148	1007	1115	973	845	762	\$
6	Turbidity	NTU	1	1	1	1	1	1	1(5)
7	TDS	mg/l	724	645	714	613	533	481	500(2000)
8	Total Hardness as CaCO ₃	mg/l	272	229.4	265.1	222.4	202.5	202.2	200(600)
9	Total Alkalinity	mg/l	219.4	204	226.1	197.3	164.3	150	200(600)
10	Calcium as Ca	mg/l	50.2	48.3	53.7	44.5	39.2	41.7	75(200)
11	Magnesium as Mg	mg/l	35.6	26.4	31.8	27.0	25.4	23.8	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	178.5	162.2	179.8	158.3	139.2	126.3	250(1000)
15	Sulphates as SO ₄	mg/l	83.3	59.7	65.4	56.3	52.1	43.6	200(400)
16	Fluorides as F	mg/l	0.6	0.3	0.6	0.5	0.3	0.4	1.0(1.5)
17	Nitrates as NO ₃	mg/l	13.4	10.5	9.7	8.3	6.3	5.4	45(NR)
18	Sodium as Na	mg/l	133.4	124.1	131.5	119.4	97.6	79.8	\$
19	Potassium as K	mg/l	8.3	6.2	5.7	4.7	5.7	3.4	\$
20	Phenolic Compounds	mg/l	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	<0.02	< 0.02	<0.02	<0.02	< 0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.23	0.17	0.08	0.11	0.08	0.11	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.23	0.34	0.27	0.33	0.25	0.33	5(15)
33	Aluminum as Al	mg/l	<0.01 <0.001	<0.01 <0.001	<0.01 <0.001	<0.01 <0.001	<0.01 <0.001	<0.01 <0.001	0.03(0.2)
34	Mercury as Hg	mg/l							0.001(NR)
35	Pesticides	μg/l	Absent						
36	E. Coil	-	Absent						
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: \$ - Limits not specified;

NR - No Relaxation

Chapter-3 Baseline Environmental Status

TABLE-3.12 GROUND WATER QUALITY

Sr.N	Parameters	Unit			GW2 – Islam	peta village			Limits as per
о.			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	IS:10500
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	pН	-	7.4	7.8	7.4	7.7	7.4	7.36	6.5 – 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1307	1210	1307	1217	1108	921	\$
6	Turbidity	NTU	1	1	1	1	1	1	1(5)
7	TDS	mg/l	837	787	824	792	710	599	500(2000)
8	Total Hardness as CaCO3	mg/l	340.4	287.7	301.0	296.2	272.1	240.5	200(600)
9	Total Alkalinity	mg/l	262.4	257	290.0	268.3	249.2	220	200(600)
10	Calcium as Ca	mg/l	72.8	63.4	71.5	60.2	54.2	48.3	75(200)
11	Magnesium as Mg	mg/l	38.5	31.4	29.7	35.4	33.2	29.1	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	203.4	181.2	190.0	178.3	160.2	138.7	250(1000)
15	Sulphates as SO ₄	mg/l	87.1	78.4	79.8	74.3	69.3	36.4	200(400)
16	Fluorides as F	mg/l	0.4	0.5	0.9	0.4	0.5	0.8	1.0(1.5)
17	Nitrates as NO ₃	mg/l	10.6	9.8	11.4	7.3	5.9	6.3	45(NR)
18	Sodium as Na	mg/l	139.3	141.9	158.2	139.5	127.3	98.7	\$
19	Potassium as K	mg/l	7.5	5.8	6.3	6.0	4.6	5.3	\$
20	Phenolic Compounds	mg/l	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	<0.02	<0.02	<0.02	<0.02	< 0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	< 0.01	< 0.01	< 0.01	<0.01	<0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	<0.001	< 0.001	< 0.001	<0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	<0.01	<0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.15	0.09	0.13	0.13	0.04	0.09	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	< 0.01	<0.01	<0.01	<0.01	<0.01	< 0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.31	0.26	0.31	0.24	0.28	0.23	5(15)
33	Aluminum as Al	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.03(0.2)
34	Mercury as Hg	mg/l	< 0.001	<0.001	<0.001	<0.001	<0.001	<0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: \$ - Limits not specified;

NR - No Relaxation

Chapter-3 Baseline Environmental Status

TABLE-3.13 GROUND WATER QUALITY

Sr.N	Parameters	Unit		GW3	– Velama Ap	pikonda vill	age		Limits as per
о.			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	IS:10500
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	pН	-	7.8	7.4	7.5	7.8	7.5	7.52	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1254	1188	1248	1074	933	854	\$
6	Turbidity	NTU	1	1	1	1	1	1	1(5)
7	TDS	mg/l	791	761	787	666	598	547	500(2000)
8	Total Hardness as CaCO ₃	mg/l	287.4	249.7	299.4	233.9	217.5	183.4	200(600)
9	Total Alkalinity	mg/l	273.8	268	272	242.3	221.2	210	200(600)
10	Calcium as Ca	mg/l	57.2	51.8	64.6	48.3	45.5	39.6	75(200)
11	Magnesium as Mg	mg/l	35.1	29.2	33.5	27.5	25.2	20.5	30(100)
12	Free Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	192.7	170.5	184.5	153.4	124.1	113.1	250(1000)
15	Sulphates as SO ₄	mg/l	66.1	73.5	81.2	65.3	59.3	47.9	200(400)
16	Fluorides as F	mg/l	0.7	0.5	0.7	0.7	0.4	0.5	1.0(1.5)
17	Nitrates as NO ₃	mg/l	11.4	7.4	6.7	10.2	6.8	7.1	45(NR)
18	Sodium as Na	mg/l	152.0	156.1	147.7	136.7	111.2	107.9	\$
19	Potassium as K	mg/l	7.2	4.1	3.7	5.4	5.4	7.2	\$
20	Phenolic Compounds	mg/l	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	<0.01	< 0.01	<0.01	<0.01	< 0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	<0.001	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	<0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	< 0.01	< 0.01	<0.01	< 0.01	< 0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.1 (0.3)
29	Iron as Fe	mg/l	0.21	0.14	0.11	0.07	0.12	0.14	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	< 0.01	< 0.01	<0.01	<0.01	<0.01	<0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.33	0.29	0.35	0.27	0.35	0.22	5(15)
33	Aluminum as Al	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.03(0.2)
34	Mercury as Hg	mg/l	<0.001	< 0.001	< 0.001	<0.001	< 0.001	< 0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: *\$ - Limits not specified;*

NR - No Relaxation

Chapter-3 Baseline Environmental Status

TABLE-3.14 GROUND WATER QUALITY

Sr.No.	Parameters	Unit		G	W4 – Dasari	peta village			Limits as per IS:10500
			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	pH	-	7.6	7.5	7.9	7.6	7.9	6.95	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	2	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1377	1251	1187	1005	905	1004	\$
6	Turbidity	NTU	1	1	1	1	1	1	1(5)
7	TDS	mg/l	896	789	772	644	589	653	500(2000)
8	Total Hardness as CaCO ₃	mg/l	349.6	319.8	289.5	248.3	225.8	273.8	200(600)
9	Total Alkalinity	mg/l	281.4	279	259	245.5	228.3	240	200(600)
10	Calcium as Ca	mg/l	73.5	67.5	62.8	55.2	52.3	65.4	75(200)
11	Magnesium as Mg	mg/l	40.3	36.7	32.2	26.8	23.1	26.8	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	205.8	182.3	169.7	122.4	104.3	136.1	250(1000)
15	Sulphates as SO ₄	mg/l	97.2	82.4	78.2	71.4	66.2	58.8	200(400)
16	Fluorides as F	mg/l	0.5	0.2	0.8	0.4	0.5	0.7	1.0(1.5)
17	Nitrates as NO ₃	mg/l	13.2	8.9	12.5	9.3	7.2	8.4	45(NR)
18	Sodium as Na	mg/l	150.4	139.6	136.5	111.4	100.3	102.5	\$
19	Potassium as K	mg/l	9.1	6.4	5.9	7.1	6.2	4.7	\$
20	Phenolic Compounds	mg/l	<0.001	< 0.001	<0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	<0.01	< 0.01	<0.01	<0.01	<0.01	<0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	<0.001	<0.001	<0.001	< 0.001	< 0.001	<0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	<0.01	<0.01	<0.01	0.01 (0.05)
26	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	<0.01	< 0.01	<0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	<0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.18	0.12	0.09	0.15	0.10	0.08	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	<0.01	<0.01	<0.01	0.05(NR)
31	Selenium as Se	mg/l	<0.01	<0.01	<0.01	<0.01	< 0.01	<0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.24	0.37	0.31	0.22	0.24	0.28	5(15)
33	Aluminum as Al	mg/l	< 0.01	< 0.01	<0.01	<0.01	< 0.01	<0.01	0.03(0.2)
34	Mercury as Hg	mg/l	<0.001	< 0.001	<0.001	< 0.001	< 0.001	<0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: *\$ - Limits not specified; NR - No Relaxation Limits are shown in IS 10500 are Ac*

ceptable limits (Requirement) and in parenthesis are Permissible limit in absence of alternate source

Chapter-3 Baseline Environmental Status

TABLE-3.15 GROUND WATER QUALITY

Sr.No	Parameters	Unit		GW	5 – Palavala	isa village			Limits as per IS:10500
•			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.2 1	18.09.2 1	
1	рН	-	7.5	7.8	7.5	7.7	7.4	7.25	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1291	1173	1277	1138	1033	977	\$
6	Turbidity	NTU	1	1	1	1	1	1	1(5)
7	TDS	mg/l	814	740	805	729	662	626	500(2000)
8	Total Hardness as CaCO ₃	mg/l	341.6	303.6	330.0	290.1	273.0	272.5	200(600)
9	Total Alkalinity	mg/l	285	265	295.0	260.5	235.6	225	200(600)
10	Calcium as Ca	mg/l	59.6	56.4	69.6	57.1	55.2	52.7	75(200)
11	Magnesium as Mg	mg/l	46.8	39.5	37.9	35.8	32.8	34.2	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	160.9	154.7	185.2	149.5	134.2	124.6	250(1000)
15	Sulphates as SO ₄	mg/l	114.1	87.5	69.6	84.2	81.2	76.5	200(400)
16	Fluorides as F	mg/l	0.7	0.6	0.5	0.7	0.4	0.5	1.0(1.5)
17	Nitrates as NO ₃	mg/l	14.8	11.6	9.8	9.4	6.9	5.8	45(NR)
18	Sodium as Na	mg/l	135.6	127.4	138.8	124.4	109.3	96.8	\$
19	Potassium as K	mg/l	6.7	5.4	6.2	6.2	4.3	3.9	\$
20	Phenolic Compounds	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	< 0.02	< 0.02	<0.02	<0.02	<0.02	<0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.24	0.19	0.15	0.22	0.15	0.12	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.18	0.32	0.23	0.33	0.25	0.16	5(15)
33	Aluminum as Al	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.03(0.2)
34	Mercury as Hg	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: \$ - Limits not specified;

NR - No Relaxation

Chapter-3 Baseline Environmental Status

TABLE-3.16 GROUND WATER QUALITY

Sr.N	Parameters	Unit			GW6 –	Rajiv Nagar			Limits as per IS:10500
о.			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	рН	-	7.9	7.5	7.7	7.4	7.8	7.32	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1308	1280	1165	1209	1174	1021	\$
6	Turbidity	NTU	1	1	1	1	1	2	1(5)
7	TDS	mg/l	851	832	758	786	764	674	500(2000)
8	Total Hardness as CaCO ₃	mg/l	355.8	350.6	314.3	333.3	304.4	283.3	200(600)
9	Total Alkalinity	mg/l	299.1	285	255.0	274.3	269.3	236	200(600)
10	Calcium as Ca	mg/l	61.0	64.2	56.4	61.4	59.2	62.8	75(200)
11	Magnesium as Mg	mg/l	49.4	46.2	42.1	43.7	38.0	30.7	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	166.5	173.1	169.4	160.3	154.3	128.2	250(1000)
15	Sulphates as SO ₄	mg/l	97.9	98.7	76.8	92.3	88.2	81.3	200(400)
16	Fluorides as F	mg/l	0.8	0.4	0.8	0.5	0.6	0.9	1.0(1.5)
17	Nitrates as NO ₃	mg/l	15.1	6.7	7.4	7.4	5.7	6.4	45(NR)
18	Sodium as Na	mg/l	131.5	129.0	119.7	122.0	126.3	101.3	\$
19	Potassium as K	mg/l	9.4	7.5	6.9	4.8	6.2	5.1	\$
20	Phenolic Compounds	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	<0.02	<0.02	<0.02	<0.02	<0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	<0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	< 0.01	<0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	0.01	0.01	0.01	0.01	< 0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.16	0.21	0.17	0.16	0.13	0.08	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	<0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.27	0.26	0.36	0.23	0.19	0.27	5(15)
33	Aluminum as Al	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.03(0.2)
34	Mercury as Hg	mg/l	<0.001	< 0.001	<0.001	<0.001	<0.001	<0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: \$ - Limits not specified;

NR - No Relaxation

Chapter-3 Baseline Environmental Status

TABLE-3.17 GROUND WATER QUALITY

Sr.N	Parameters	Unit		GW	7 – Gouruva	nipalem vill	age		Limits as per
о.			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	IS:10500
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21	
1	рН	-	7.8	7.6	7.8	7.6	7.5	7.72	6.5 - 8.5 (NR)
2	Colour	Hazen	1	1	1	1	1	1	5(15)
3	Taste	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
4	Odour	-	Agre	Agre	Agre	Agre	Agre	Agre	Agreeable
5	Conductivity	µS/cm	1226	1134	1291	1142	1228	866	\$
6	Turbidity	NTU	1	1	1	1	2	1	1(5)
7	TDS	mg/l	785	726	827	743	774	563	500(2000)
8	Total Hardness as CaCO ₃	mg/l	346.7	301.7	343.1	299.5	315.9	222	200(600)
9	Total Alkalinity	mg/l	261.8	268	273.6	263.4	275.7	180	200(600)
10	Calcium as Ca	mg/l	62.3	59.6	72.2	62.7	60.2	53.4	75(200)
11	Magnesium as Mg	mg/l	46.4	37.1	39.5	34.7	40.2	21.5	30(100)
12	Residual Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2(1)
13	Boron	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5(1)
14	Chlorides as Cl	mg/l	184.1	158.7	188.2	162.5	175.2	131	250(1000)
15	Sulphates as SO ₄	mg/l	75.1	64.2	95.4	69.3	77.8	57.2	200(400)
16	Fluorides as F	mg/l	0.5	0.6	0.6	0.4	0.5	0.4	1.0(1.5)
17	Nitrates as NO ₃	mg/l	11.4	5.9	4.8	8.1	10.1	9.8	45(NR)
18	Sodium as Na	mg/l	117.1	119.2	136.6	121.5	134.1	95.1	\$
19	Potassium as K	mg/l	8.3	5.3	3.8	7.2	5.7	4.6	\$
20	Phenolic Compounds	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.001(0.002)
21	Cyanides	mg/l	<0.02	< 0.02	<0.02	<0.02	<0.02	<0.02	0.05 (NR)
22	Anionic Detergents	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	0.2 (1.0)
23	Mineral Oil	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.5 (NR)
24	Cadmium as Cd	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	0.003 (NR)
25	Arsenic as As	mg/l	<0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (0.05)
26	Copper as Cu	mg/l	0.01	0.01	0.01	0.01	<0.01	< 0.01	0.05 (1.5)
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01 (NR)
28	Manganese as Mn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.1 (0.3)
29	Iron as Fe	mg/l	0.18	0.13	0.23	0.18	0.09	0.11	0.3(NR)
30	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.05(NR)
31	Selenium as Se	mg/l	<0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	0.01(NR)
32	Zinc as Zn	mg/l	0.22	0.30	0.27	0.37	0.29	0.23	5(15)
33	Aluminum as Al	mg/l	<0.01	< 0.01	< 0.01	<0.01	< 0.01	< 0.01	0.03(0.2)
34	Mercury as Hg	mg/l	<0.001	<0.001	<0.001	<0.001	<0.001	<0.001	0.001(NR)
35	Pesticides	μg/l	Absent	Absent	Absent	Absent	Absent	Absent	Absent
36	E. Coil	-	Absent	Absent	Absent	Absent	Absent	Absent	Absent
37	Total Coliforms	MPN/100	<2	<2	<2	<2	<2	<2	10

Note: \$ - Limits not specified;

NR - No Relaxation

Chapter-3 Baseline Environmental Status

S. No.									RILTO SEPT					
5. 110.	Parameter	Units	Ар	or 21	May	y 21	Jur	21	Jul	21	Au	g 21	Sep	21
			SW2	SW3	SW2	SW3	SW2	SW3	SW2	SW3	SW2	SW3	SW2	SW3
			17.04.21	17.04.21	12.05.21	12.05.21	16.06.21	16.06.21	14.07.21	14.07.21	21.08.21	21.08.21	18.09.21	18.09.21
1	рН	-	7.8	8.0	7.6	7.9	7.8	8.0	7.9	8.1	8.0	7.8	7.84	7.74
2	Color	Hazen	4	6	5	4	6	5	1	1	1	1	1	1
3	Conductivity	□S/cm	50830	51450	48230	49125	47835	48630	48805	47910	47035	48120	48220	47855
4	Total Dissolved Solids	mg/l	37615	37560	35690	36850	35400	36480	36120	35940	34810	35130	35685	34935
5	DO	mg/l	5.4	5.5	5.2	5.4	5.4	5.5	5.3	5.4	5.4	5.2	5.3	5.4
6	BOD	mg/l	<3	<3	<3	<3	<3	<3	<3	<3	<3	<3	<3	<3
7	COD	mg/l	108	117	112	104	107	121	112	104	121	117	114	109
8	Total Hardness as CaCO ₃	mg/l	4624.8	4684.1	4250.1	4409.9	4345.7	4054.3	4309.7	4219.9	3921.4	4244.0	4158	4230.1
9	Total Alkalinity as CaCO ₃	mg/l	289.4	325	278	290	210	270	291.0	282.0	277.3	298.3	285	250
10	Calcium as Ca ⁺²	mg/l	431	418.5	391.4	429.0	412.5	384.2	435.0	407.3	409.2	412.0	398.5	382.4
11	Magnesium as Mg ⁺²	mg/l	862	884	795.0	811.0	805.4	751.8	783	778	704.3	781.0	768.3	795.6
12	Chlorides as Cl	mg/l	16665	17004	15979.0	16428.0	16025	16352	16234	15983	15702	16023	15986	16010
13	Residual free Chlorine	mg/l	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2	<0.2
14	Phosphates PO ₄	mg/l	2.5	2.0	2.5	3.4	3.1	2.8	2.6	1.7	3.5	2.7	2.5	3.0
15	Sulphates as SO ₄	mg/l	1193	1067	1098	994	978	875	983	912	923	267.2	1135	989
16	Fluorides as F	mg/l	0.5	0.6	0.8	1.0	1.2	1.1	0.6	0.8	0.4	0.6	0.9	0.8
17	Nitrates as NO ₃	mg/l	13.7	14.3	10.2	8.7	4.7	6.8	8.3	10.2	9.2	12.1	8.6	11.5
18	Sodium as Na ⁺	mg/l	9369	9444	8964	9078	8825.6	9134.0	9062	8877	8860	8900	9020	8875
19	Potassium as K	mg/l	313.4	390.0	289	324	272.0	316	292.4	341.5	256.0	360.0	262	310
20	Total Boron as B	mg/l	0.04	0.02	0.02	0.01	0.03	0.02	0.04	0.03	0.06	0.04	0.03	0.07
21	Cyanides	mg/l	< 0.02	< 0.02	< 0.02	< 0.02	< 0.02	<0.02	<0.02	< 0.02	< 0.02	< 0.02	< 0.02	< 0.02
22	Phenol compounds	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001
23	Oil and Grease	mg/l	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0	<1.0
24	Cadmium as Cd	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001
25	Arsenic as As	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
26	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
27	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
28	Iron as Fe	mg/l	0.18	0.25	0.11	0.19	0.09	0.08	0.20	0.16	0.17	0.12	0.21	0.12
29	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
30	Selenium as Se	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
31	Zinc as Zn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
32	Aluminium as Al	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
33	Mercury as Hg	mg/l	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001	< 0.001

TABLE-3.18 SURFACE WATER QUALITY (MARINE WATER SAMPLES) FROM APRILTO SEPTEMBER 2021

SW2- Appikonda beach(marine); SW3-Tikkavanipalem beach(marine);

VIMTA Labs Limited, Hyderabad



Chapter-3 Data Analysis

TABLE-3.19 SURFACE WATER QUALITY (CREEK WATER SAMPLES) FROM APRIL TO SEPTEMBER 2021

S.No	Parameters	Units	Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21
			17.04.21	12.05.21	16.06.21	14.07.21	21.08.21	18.09.21
1	рН	-	7.6	7.9	7.6	7.9	7.6	8.11
2	Suspended solids	mg/l	51	45	38	27	37	32
3	Conductivity	μS/cm	31540	32027	33245	34005	31745	30235
4	TDS	mg/l	21448	22100	23275	23805	21905	20865
5	DO	mg/l	5.6	5.4	5.3	5.3	5.5	5.3
6	BOD	mg/l	<3	<3	<3	<3	<3	<3
7	Turbidity	NTU	25	29	36	29	35	29
8	Salinity	ppt	19.5	20	21	21	20	19
9	Total Alkalinity as CaCO ₃	mg/l	152.3	140.3	160	293.4	324.2	290
10	Calcium as Ca	mg/l	156.3	143	171.6	176.1	162.3	158.7
11	Magnesium as Mg	mg/l	354.2	298.7	318.7	362.0	344.2	337.5
12	Chlorides as Cl	mg/l	10876	11087	11489.6	11564	10755	10298
13	Phosphates as PO ₄	mg/l	3.5	2.3	3.7	2.1	4.2	2.9
14	Sulphates as SO ₄	mg/l	102.4	212.3	198.0	243.2	266.0	247
15	Fluorides as F	mg/l	0.7	0.45	1.0	0.8	0.9	1.0
16	Nitrates as NO ₃	mg/l	12.9	9.8	7.2	10.3	8.4	10.2
17	Sodium as Na	mg/l	6327	6571	6767	6837	6377	6056
18	Potassium as K	mg/l	122.4	131.2	124.5	155.6	143.0	128
19	Phenolic Compounds	mg/l	< 0.001	<0.001	< 0.001	< 0.001	< 0.001	<0.001
20	Copper as Cu	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
21	Lead as Pb	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
22	Iron as Fe	mg/l	0.22	0.16	0.16	0.25	0.21	0.19
23	Chromium as Cr ⁺⁶	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01
24	Zinc as Zn	mg/l	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01

Creek water in Mud flat area at Vade cheepurapalli.



Chapter-3 Data Analysis

3.6 Soil Quality

Soil Samples were collected from eight locations around the plant site area, out of which, three locations (S1 to S3) are monthly and the remaining five locations (S4 to S8) are quarterly samples. The soil quality is given below in **Table-3.20** and **Table-3.25**.

S. No	Parameters	Unit		S	1 –Palavalas	sa Village		
			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21
			20.04.21	12.05.21	09.06.21	14.07.21	14.08.21	22.09.21
1	Texture		Sandy Clay	Sandy	Sandy	Sandy	Sandy	Sandy
1	Texture			Clay	Clay	Clay	Clay	Clay
а	Sand	%	54	51	49	52	49	47
b	Silt	%	11	10	13	15	15	14
С	Clay	%	35	39	38	33	36	39
2	Bulk Density	g/cc	1.4	1.2	1.2	1.2	1.3	1.2
3	pH (1:5 Aq.Extraction)		7.4	7.3	7.23	7.41	7.6	7.46
4	Conductivity (1:5 Aq.Extraction)	μS/cm	398	416	382	417	410	397
5	Cation Exchange Capacity	(meq/100gm)	24.8	20.1	24.14	20.53	20.6	22.3
6	Exchangeable Calcium	(meq/100gm)	15.4	13.19	15.8	13.45	14.8	13.2
7	Exchangeable Magnesium	(meq/100gm)	8.7	6.23	7.69	6.53	5.19	8.51
8	Exchangeable Potassium	(meq/100gm)	0.40	0.29	0.39	0.21	0.29	0.25
9	Exchangeable Sodium	(meq/100gm)	0.27	0.35	0.29	0.34	0.38	0.28
10	Sodium Absorption Ratio (SAR)		0.13	0.10	0.12	0.15	0.17	0.15
11	Available Nitrogen as N	Kg/ha	88.7	78.2	89.4	102.2	55.3	63.8
12	Available Phosphorous as P	Kg/ha	58.4	46.4	54.0	88.3	66.5	73.6
13	Available Potassium as K	Kg/ha	287.0	253.3	281.6	153.1	226.1	182.7
14	Organic Carbon	%	0.44	0.39	0.44	0.51	0.25	0.32
15	Organic Matter	%	0.76	0.67	0.76	0.88	0.46	0.55
16	Water Soluble Chlorides as Cl	mg/kg	109.6	112	92.1	109.9	98.7	82.3
17	Water Soluble Sulphates as SO4	mg/kg	40.1	56.3	43.27	69.2	53.2	45.3
18	Aluminium	%	0.98	0.82	0.76	0.81	0.96	1.02
19	Total Iron	%	1.27	1.14	1.08	1.12	1.25	1.34
20	Manganese	mg/kg	436	397	428	398	415	356
21	Boron	mg/kg	32.6	28.6	21.7	19.6	21.5	19.6
22	Zinc	mg/kg	43.2	47.4	34.6	28.6	32.4	26.2

TABLE-3.20 SOIL QUALITY RESULTS



Chapter-3 Data Analysis

TABLE-3.21 SOIL QUALITY RESULTS

S. No	Parameters	Unit			S2 –Appik	onda Villag	e	
			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21
			20.04.21	12.05.21	09.06.21	14.07.21	14.08.21	22.09.21
1	Texture		Clay	Clay	Clay	Clay	Clay	Clay
а	Sand	%	25	27	25	21	27	25
b	Silt	%	16	15	12	23	20	17
С	Clay	%	59	58	63	56	53	58
2	Bulk Density	g/cc	1.2	1.1	1.1	1.1	1.2	1.1
3	pH (1:5 Aq.Extraction)		7.8	7.6	7.37	7.8	7.8	7.82
4	Conductivity (1:5 Aq.Extraction)	µS/cm	587	674	539	623	582	542
5	Cation Exchange Capacity	(meq/100gm)	36.4	28.7	33.23	30.28	25.4	29.1
6	Exchangeable Calcium	(meq/100gm)	22.7	18.44	21.2	19.07	18.2	16.4
7	Exchangeable Magnesium	(meq/100gm)	12.8	9.38	11.03	10.40	6.28	11.86
8	Exchangeable Potassium	(meq/100gm)	0.53	0.45	0.59	0.32	0.40	0.42
9	Exchangeable Sodium	(meq/100gm)	0.42	0.49	0.44	0.49	0.44	0.43
10	Sodium Absorption Ratio (SAR)		0.14	0.17	0.16	0.18	0.18	0.19
11	Available Nitrogen as N	Kg/ha	154.7	132.3	119.0	141.5	114.6	122.6
12	Available Phosphorous as P	Kg/ha	93.5	68.7	72.4	116.5	51.3	93.7
13	Available Potassium as K	Kg/ha	350.4	326.3	394.2	214.1	286.8	276.6
14	Organic Carbon	%	0.84	0.72	0.65	0.77	0.57	0.67
15	Organic Matter	%	1.45	1.24	1.12	1.33	0.98	1.15
16	Water Soluble Chlorides as Cl	mg/kg	152.2	145	135.3	143.5	125.6	114.5
17	Water Soluble Sulphates as SO4	mg/kg	63.0	69.2	74.27	95.3	84.5	91.5
18	Aluminium	%	1.26	1.12	1.32	1.26	1.15	1.24
19	Total Iron	%	1.78	1.56	1.64	1.54	1.68	1.92
20	Manganese	mg/kg	614	584	654	567	598	487
21	Boron	mg/kg	54.6	63.5	54.3	41.6	36.4	28.5
22	Zinc	mg/kg	63.4	56.8	67.8	52.4	48.6	36.2



Chapter-3 Data Analysis

TABLE-3.22 SOIL QUALITY RESULTS

S. No	Parameters	Unit		:	S3 –Devada	Village		
			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21
			20.04.21	12.05.21	09.06.21	14.07.21	14.08.21	22.09.21
1	Texture		Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay	Sandy Clay
а	Sand	%	48	46	51	49	47	49
b	Silt	%	10	13	14	15	14	15
С	Clay	%	42	41	35	36	39	36
2	Bulk Density	g/cc	1.4	1.3	1.2	1.2	1.3	1.2
3	pH (1:5 Aq.Extraction)		7.2	7.7	7.74	7.2	7.4	7.32
4	Conductivity (1:5 Aq.Extraction)	μS/cm	403	387	436	369	394	356
5	Cation Exchange Capacity	(meq/100gm)	27.3	22.3	25.95	21.90	22.1	24.2
6	Exchangeable Calcium	(meq/100gm)	16.1	14.27	16.1	13.71	16.3	13.8
7	Exchangeable Magnesium	(meq/100gm)	10.6	7.48	9.15	7.63	4.98	9.91
8	Exchangeable Potassium	(meq/100gm)	0.37	0.27	0.37	0.19	0.36	0.23
9	Exchangeable Sodium	(meq/100gm)	0.33	0.27	0.35	0.38	0.43	0.24
10	Sodium Absorption Ratio (SAR)		0.10	0.12	0.14	0.17	0.19	0.16
11	Available Nitrogen as N	Kg/ha	95.7	89.0	76.6	106.2	96.9	89.5
12	Available Phosphorous as P	Kg/ha	70.9	59.8	48.7	72.7	78.0	65.4
13	Available Potassium as K	Kg/ha	271.0	212.0	267.5	138.8	284.7	167.2
14	Organic Carbon	%	0.48	0.41	0.38	0.53	0.45	0.45
15	Organic Matter	%	0.82	0.71	0.66	0.91	0.76	0.77
16	Water Soluble Chlorides as Cl	mg/kg	99.2	103	113.4	101.0	86.5	74.3
17	Water Soluble Sulphates as SO4	mg/kg	39.3	48.8	37.89	56.6	48.6	52.7
18	Aluminium	%	1.01	0.93	0.82	0.69	0.72	0.87
19	Total Iron	%	1.38	1.24	1.18	1.37	1.41	1.21
20	Manganese	mg/kg	389	405	382	412	396	382
21	Boron	mg/kg	29.8	25.4	19.8	23.2	19.7	21.4
22	Zinc	mg/kg	34.6	28.6	22.5	31.6	27.4	23.1



Chapter-3 Data Analysis

TABLE-3.23 SOIL QUALITY RESULTS (QUARTERLY)

S. No	Parameters	Unit	S4	S5	S6	S7	S8
	Sampling date		09.06.21	09.06.21	09.06.21	09.06.21	09.06.21
1	Texture		Sandy	Sandy Clay	Sandy Clay	Sandy Clay	Sandy
А	Sand	%	62	51	48	47	64
В	Silt	%	16	13	12	16	19
С	Clay	%	22	36	40	37	17
2	Bulk Density	g/cc	1.3	1.2	1.2	1.3	1.3
3	pH (1:5 Aq.Extraction)		7.3	7.4	7.2	7.5	7.4
4	Conductivity (1:5 Aq.Extraction)	µS/cm	387	412	392	454	436
5	Cation Exchange Capacity	(meq/100gm)	25.83	31.61	30.18	32.99	28.17
6	Exchangeable Calcium	(meq/100gm)	17.14	20.62	19.94	21.16	18.61
7	Exchangeable Magnesium	(meq/100gm)	8.15	10.45	9.71	11.30	9.15
8	Exchangeable Potassium	(meq/100gm)	0.30	0.25	0.22	0.26	0.19
9	Exchangeable Sodium	(meq/100gm)	0.24	0.29	0.33	0.27	0.22
10	Sodium Absorption Ratio (SAR)		0.10	0.11	0.12	0.09	0.09
11	Available Nitrogen as N	Kg/ha	28.6	36.5	19.8	34.9	24.7
12	Available Phosphorous as P	Kg/ha	46.8	84.3	61.6	56.9	41.7
13	Available Potassium as K	Kg/ha	235.8	183.6	156.8	206.5	150.3
14	Organic Carbon	%	0.18	0.24	0.21	0.32	0.21
15	Organic Matter	%	0.31	0.41	0.36	0.55	0.36
16	Water Soluble Chlorides as Cl	mg/kg	136	187	156	172	129
17	Water Soluble Sulphates as SO4	mg/kg	98	134	121	112	84
18	Aluminium	%	1.98	2.34	2.12	1.87	1.64
19	Total Iron	%	2.94	3.11	2.97	2.54	2.71
20	Manganese	mg/kg	398	526	498	576	412
21	Boron	mg/kg	19.8	31.5	29.6	41.6	34.8
22	Zinc	mg/kg	45.2	56.4	67.2	71.2	48.6

Soil Sampling Locations

S4- Islampeta village

S5- Namidoddi village

S6- Palikiladoddi village

S7- Dasaripeta village

S8- 8th feet road (Near Islampet village)



Chapter-3 Data Analysis

TABLE-3.24 SOIL QUALITY RESULTS (QUARTERLY)

S. No	Parameters	Unit	S4	S5	S6	S7	S8
5. NO	Falameters	Onic	14.08.21	14.08.21	14.08.21	14.08.21	14.08.21
1	Texture		Sandy	Sandy Clay	Sandy Clay	Sandy Clay	Sandy
А	Sand	%	67	49	47	45	62
В	Silt	%	10	14	15	12	13
С	Clay	%	23	37	38	43	25
2	Bulk Density	g/cc	1.23	1.28	1.31	1.25	1.19
3	pH (1:5 Aq.Extraction)		7.5	7.1	7.9	7.6	7.4
4	Conductivity (1:5 Aq.Extraction)	µS/cm	418	395	365	435	353
5	Cation Exchange Capacity	(meq/100gm)	19.5	22.3	29.3	26.4	23.7
6	Exchangeable Calcium	(meq/100gm)	15.3	14.9	17.5	18.4	19.2
7	Exchangeable Magnesium	(meq/100gm)	5.77	6.79	8.03	7.14	6.62
8	Exchangeable Potassium	(meq/100gm)	0.25	0.16	0.25	0.34	0.29
9	Exchangeable Sodium	(meq/100gm)	0.60	0.45	0.50	0.53	0.55
10	Sodium Absorption Ratio (SAR)		0.26	0.19	0.20	0.21	0.22
11	Available Nitrogen as N	Kg/ha	83.7	74.8	96.1	80.8	50.9
12	Available Phosphorous as P	Kg/ha	33.6	53.4	52.3	64.8	35.7
13	Available Potassium as K	Kg/ha	185.9	124.0	199.8	256.1	211.0
14	Organic Carbon	%	0.41	0.35	0.44	0.39	0.26
15	Organic Matter	%	0.70	0.60	0.76	0.67	0.44
16	Water Soluble Chlorides as Cl	mg/kg	128	174	148	164	131
17	Water Soluble Sulphates as SO4	mg/kg	81.5	124.2	116.5	98.7	72.9
18	Aluminium	%	1.84	2.14	1.98	1.74	1.58
19	Total Iron	%	2.76	2.93	2.86	2.39	2.54
20	Manganese	mg/kg	386	498	512	481	374
21	Boron	mg/kg	21.5	26.4	32.1	29.2	33.5
22	Zinc	mg/kg	36.7	49.5	57.2	68.3	42.2

Soil Sampling Locations

S4- Islampeta village

S5- Namidoddi village

S6- Palikiladoddi village

S7- Dasaripeta village

S8- 8th feet road (Near Islampet village)



Chapter-3 Data Analysis

3.7 Waste Water Quality

3.7.1 Effluent Treatment Plant and Outfall water at diffusion point water Quality

There are one ETP water inside plant and two Outfall water at diffusion point these sample were collected and these were as per analyzed as per the standards to know the quality of water. The Summary of analyzed parameters results is given in **Table-3.25**.

TABLE-3.25 ETP OUTLET ANALYSIS RESULT AT PLANT SITE

Sr.no	Parameters	Unit	Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21	Standards						
1	рН	-		•					6.50-8.50						
2	Total Suspended Solids (at 103—105° C)	mg/l			100 mg/l										
3	Oil and Grease	mg/l	20 mg/l												
4	Free chlorine	mg/l		Plant Shutdown											
5	Phosphate as PO4	mg/l													
6	Chromium (Total)	mg/l													
7	Copper (Total)	mg/l							1 mg/l						
8	Iron	mg/l													
9	Zinc	mg/l]												
10	BOD (3 day 27 ^o C)	mg/l													
11	Fecal Coliform	MPN/100 ml							1000 MPN/100 ml						

3.8 Stack Emission Monitoring

The power plant has stack of height 275.0-m, which is the major source of air pollution. The stack emission monitoring for Unit–I and Unit-II has been carried out and results are given in **Table-3.26**.

TABLE-3.26 STACK EMISSION MONITORING

Sr. No.	Parameters	UOM	Unit- I&II	Unit- I&II	Unit- I&II	Unit- I&II	Unit- I&II	Unit- I&II	Methods of Testing		
			Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21			
	Sampling date										
1	Capacity	MW							-		
2	Stack Height	М							-		
3	Stack diameter	М							-		
4	Cross sectional area of the duct	m²		Plant Shutdown				-			
5	Flue gas Temperature	°C							-		
6	Velocity of the flue gas	m/s						IS: 11255(P-3) 2008			
7	Gas volumetric flow rate	Nm³/s	IS: 11255(P-								
8	Particulate Matter	mg/Nm ³	³ IS: 11255(P-								
9	Sulphur dioxide	mg/Nm ³			IS: 11255(P-7) 2012						
10	Oxides of Nitrogen	mg/Nm ³						IS: 11255(P-2) 1985			



Chapter-3 Data Analysis

3.9 Pizeo wells Monitoring

Pizeo wells Monitoring of ground water has been carried out for 6 locations around the plant site and the Pizeo wells water level monitoring are given in **Table-3.27.**

TABLE-3.27 PIZEO WELLS MONITORING FOR GROUND WATER

Sr.No.	Location Name	Depth of Water levels (m)				
		10.04.21	19.06.21	21.08.21		
1	Appikonda village	4.15	4.56	3.20		
2	Palavalasa village	2.60	3.10	2.83		
3	Velama Appikonda village	6.45	6.22	4.10		
4	Gouruvanipalem village	5.66	4.87	3.22		
5	Islampet village	6.24	5.92	3.88		
6	Dasaripeta villa	5.42	5.74	4.23		

3.10 Sewage Treatment Plant Outlet Water Quality (STP)

Two Sewage water samples are collected one is from Plant site and other is Colony and analyzed for various parameters. The survey analytical results are given in **Table-3.28**.

TABLE-3.28 SEWAGE OUTLET WATER QUALITY (APRIL TO SEPTEMBER 2021)

Sr. No	_	иом	Apr 21	May 21	Jun 21	Jul 21	Aug 21	Sep 21
	Parameter		Plant Site	Plant Site	Plant Site	Plant Site	Plant Site	Plant site
	Sampling date		06.04.21			23.07.21	21.08.21	08.09.21
1	рН	-	7.6			7.8	7.5	7.9
2	Oil & Grease	mg/l	<1.0			<1.0	<1.0	<1.0
3	Total Dissolved Solids	mg/l	518	Plant	Plant	574	533	489
4	Total Suspended Solids	mg/l	53	Shutdown	Shutdown	56	62	47
5	Bio Chemical Oxygen Demand for 3 day 27°C	mg/l	15			13	12	10
6	Fecal Coliform (FC) MPN/100ml	MPN/100 ml	<1.8			<1.8	<1.8	<1.8



3.11 Beach Profile Study

Hinduja National Power Corporation Limited (HNPCL) is a Hinduja Group company to realize the ambitions of the Group in Power Sector. HNPCL is setting up a 1,040 MW coal-based merchant power plant at Vizag, Andhra Pradesh. Once Through (Open Cycle) Cooling System has been recommended by MoEF for the power plant and Sea Water Intake-Outfall System has been installed.

The present study involves quarterly monitoring of shoreline and beach profile changes as

part of environmental monitoring and compliance to MoEF:

- 1. shoreline within 3 km on either side of HNPCL Sea Water Intake-Outfall System (Jetty) and
- 2. beach profile at HNPCL Jetty and at 100 m, 250 m and 500 m intervals on either side of Jetty

3.11.1 Shoreline

The coastal areas are always physically and ecologically changing that depends to natural and human factors. Monitoring of coastal areas is an important fact in steady development and environment maintenance. To monitor a coastal area, shoreline extraction in various times is an essential task. Shoreline is one the most important linear features on the Earth's surface showing a dynamic nature. It is important to produce shoreline map and to determine the changes for a secure shipping, resource management, environment maintenance, planning and coastal steady-development.

Remote sensing is one of the best and most reliable methods in monitoring and management off environment and resources. Since, the reflection of water in IR bands are almost zero and most of vegetation have a bigger reflection versus water, shoreline can be extracted from even one band of the image.

Cartosat 1 with improved spatial resolution capability it will provide enhanced inputs for large scale mapping applications and stimulate newer applications in the urban and rural development, land and water resources management, coastal mapping etc. Hence, high resolution satellite data during March/April 2021 has been proposed to carry out investigation on spatial changes of shoreline monitoring. Since could free 2.5 m resolution data close to field profile study i.e., 11-Mar-2021 is not available, Resourcesat 2 L4FMX multispectral satellite data of 5 m resolution on 21-April-2021 has been procured to draw shore lines during April 2021. The Resourcesat 2 L4FMX satellite data of 5 m resolution of 21-April-2021 obtained from NRSC is geometrically corrected with respect to Survey of India toposheet and GCPs collected from field. To carry out the geo-referencing, ground control points (GCPs) were identified on the maps and raw satellite data. The coefficients for two co-ordinate transformation equations were computed based on polynomial regression between GCPs on map and satellite data.




Chapter-3 Data Analysis

Alternate GCPs were generated till the Root Mean Square (RMS) error was less than 0.5 pixel and then both the images were co-registered.

Shore line and High Tide Shore lines are delineated from processed Resourcesat 2 L4FMX image of 21-April-2021 using visual interpretation technique in conjunction with LTL, HTL and CRZ Map prepared by National Institute of Oceanography and field data provided by VIMTA Labs Ltd. The above-mentioned satellite data covering 3.5 km on either side of Jetty point has been used to present shore line changes. "The line on the land up to which the highest water line reaches during the spring tide" indicated by vegetation line and clear beach is delineated as Shore Line (SL). High Tide Shore Line (HTSL) is plotted following line of moisture indication along the tidal zone on the satellite image. Mapping of SL and HTSL is done on scale of 1:8000.

The observations in respect of SL and HTSL are presented in **Figure-3.5** for 21-April-2021. From the shoreline map, it is observed that there is no major change in SL and no activity or discharge around jetty. The difference in HTSL observed may be due to fluctuations caused by changes in seasonal tides/gravitational forces exerted by the moon and the sun, and the rotation of the Earth.

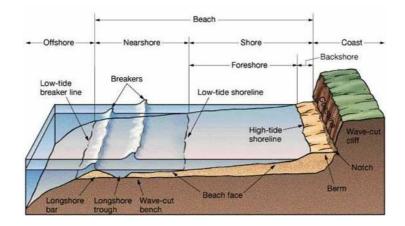





Chapter-3 Data Analysis



FIGURE-3.5 SHORELINE SATELLITE IMAGERY OF HTSL, RESOURCESAT 2 L4FMX-5M (21 <u>APRIL 2021)</u>



3.11.2 Beach Profiles

Measuring beach profiles is an ideal activity for science-based assessments and science fair projects. Beach size often changes so quickly – in a matter of days – those interesting results can be guaranteed in short time period. Furthermore, the information gathered may also be useful for environmental management and planning.

The monitoring consists of surveying the beach profile from a fixed point set up behind the beach. The fixed point is called the reference mark and is the starting point the measurement. The reference mark is usually painted on a permanent feature like wall or tree or a pillar established. In the absence of any permanent features here, 1'x1'x3' pillar stones are installed (at 7.1 m, 100 m, 250 m & 500 m towards east of Jetty and 8.1 m, 100 m, 250 m & 500 m towards west of Jetty) as reference marks and painted with profile identification numbers. Reference marks, profile sections and profile line along the beach are shown in **Figure 3.6**. Beach profile measurements are run from the installed reference marks at right angles across the beach on 11.03.2021. Beach profile measurements are done using an Abney Level & Clinometer placing ranging poles at each break of slope and ensuring the line of profile follows the fixed orientation. The measurements are continued a few meters into the sea water beyond low tide.



FIGURE-3.6 HNPCL JETTY AND PROFILE LOCATIONS ON GOOGLE EARTH MAP



> Chapter-3 Data Analysis

High and low tide levels are measured as observed on the day and time of measurements considering the moisture indication and current tide level respectively. Summary of profiles carried out giving the details of length, vertical drop w.r.t reference mark and area of profile are presented in **Table 3.29** and individual profiles are presented in **Figure 3.7 to 3.11**

Total length of profiles ranges from 29.38 m at W250 to 62.63 m at W100 from the reference mark in to the offshore with vertical drop w.r.t reference mark ranging from 1.899 m to 5.338 m and sectional profile area ranging from 44.72 sq m to 202.79 sq m.


Sr.No.	Profile ID	Latitude	Longitude	Elevation at Ref. Mark (m amsl)	Total Length (m)	Vertical Drop w.r.t Ref. Mark (m)	Profile Area (sq m)
1	E7.1	17 º 33' 17.7''N	83 º 08' 26.3''E	3.62	30.15	1.899	44.72
2	E100	17 ⁰ 33' 18.6''N	83 º 08' 29.2''E	3.31	32.93	2.385	54.34
3	E250	17 ⁰ 33' 20.2''N	83 ⁰ 08' 34.0''E	5.32	56.36	3.586	125.53
4	E500	17 ⁰ 33' 22.2''N	83 º 08' 42.4''E	3.31	39.23	3.837	85.34
5	W8.1	17 ⁰ 33' 17.6''N	83 ⁰ 08' 24.9''E	4.54	53.19	5.338	202.79
6	W100	17 º 33' 16.5''N	83 ° 08' 21.9''E	4.40	62.63	2.279	86.36
7	W250	17 ⁰ 33' 15.2''N	83 ° 08' 16.9''E	3.60	29.38	3.580	69.50
8	W500	17 ⁰ 33' 13.0''N	83 ⁰ 08' 08.6''E	3.50	37.50	5.105	120.75

TABLE-3.29 DETAILS OF PROFILES ON 11.03.2021











Chapter-3 Data Analysis





FIGURE-3.8 BEACH PROFILE – EAST 250 & EAST 500 METERS FROM JETTY 11.03.2021







FIGURE-3.9 BEACH PROFILE – WEST 8.1 & WEST 100 METERS FROM JETTY 11.03.2021







FIGURE-3.10 BEACH PROFILE – WEST 250 & WEST 500 METERS FROM JETTY 11.03.2021



Chapter-3 Data Analysis

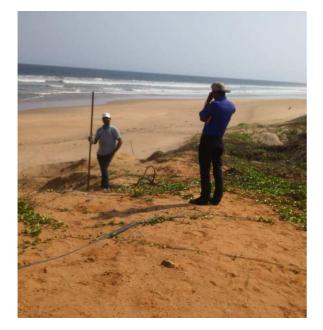






FIGURE 3.11 SITE PHOTO GRAPHS OF BEACH PROFILE STUDY AREA

VIMTA Labs Limited, Hyderabad



3.12 Biological characteristics

3.12.1 Phytoplankton

Phyto-pigments: Phyto-pigments such as Chlorophyll-a / Chlorophyll-b Chlorophyll-c, Carotenoids / Phaeopigments.

3.12.1.1The Genetic diversity of the Phyto-planktons is presented in the **Table-3.30**.

	Phytop	lankton Genetic Diversity
Chlorop	hyaceae	Genetic Diversity
1	Cosmarium	21
2	Chara	11
3	Cladophora	6
4	Chlorilla	9
5	Chlamydomonas	7
6	Volvox	6
7	Hydrodicto	4
8	Spirodictiona	11
9	Spirozyra	7
10	Zygenema	15
Cyanopl	nyaceae	
11	Spirulina	12
12	Anabaena	6
13	Nostoc	10
Bacillari	iophyaceae	
14	Pinnularia	13
15	Navicula	7
Shannon	Wiener Diversity	0.86
Index for	- Species Diversity	
Species I	Richness	3

TABLE-3.30 PHYTOPLANKTON GENETIC DIVERSITY

Population of biomass comprises of 15 species of phyto-planktons.



Chapter-3 Data Analysis

3.12.1.2 The genetic diversity of the Zooplankton is given in the **Table-3.31**

TABLE-3.31 ZOOPLANKTON GENETIC DIVERSITY

	Zooplankton Gene	etic Diversity
Сореро	da	Genetic Diversity
1	<i>Cyclops</i> sp	9
2	Nauplius larvae	16
Rotifera	1	
1	Brachionus sp	9
2	Allonella sp	13
3	<i>Moina</i> sp	10
Protozo	a	
1	<i>Pinnularia</i> sp	8
Shannor	Wiener Diversity	0.974
Index fo	r Species Diversity	
Species	Richness	3

3.13.1<u>Benthos</u>

3.13.1.1 Meiobenthos

Community of Benthos are represented by Meiobenthos and Macro benthos. The Meiobenthos communities are represented such as Copepods, and turbellarians, Listed in **Table-3.32**.

TABLE-3.32 MEIOBENTHIC GROUP

Sr. No.	Meiobenthos	Genetic Diversity
1	Copepods	7
2	Nematodes	10
3	Turbellarians	11
4	Nemertins	8
5	Foraminifera	9
6	Kinorynchs	5
7	Halacarids	10
	n Wiener Diversity Index - Diversity	1.92
Species	Richness	7



3.12.2.2 Macro benthos

Represented by *Polychaetes*, *Molluscs*, *Amphipods*, *Isopods*, *Cnidarians*, listed in **Table-3.33.**

TABLE-3.33 MACROBENTHIC GROUP

Sr. No.	Macrobenthos	Genetic Diversity
1	Polychaetes	13
2	Molluscs	8
3	Cumceans	6
4	Amphipods	17
5	Isopods	10
6	Cnidarians	6
7	Oligochaetes	7
8	Tanaidacea	12
Shannon Species I	Wiener Diversity Index - Diversity	2.01
Species	Richness	8

<u>Fishes</u>

The list of fish found near the study area, near the plant site listed in **Table-3.34.**

TABLE-3.34 LIST OF FISHES IN THE STUDY AREA

Sr. No	Name of the Species	Number of Individuals	Common Name
Fishes			
1	Rasterliger kanagurta	22	Indian Mackerel
2	Sarinella longiceps	16	Indian Oil Sardine
3	Canos charios	19	White Mullet
Shannon V - Species	Viener Diversity Index Diversity	1.09	
Species Ri	chness	3	

Thus indicating the Genetic diversity of Phytoplankton, *Meiobenthos* and *Macrobenthos* and fishes in the study area.

Annexure-I Ambient Air Quality Levels

AAQ1 - Palavalasa village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	08/04/2021	23.1	53.5	10.1	14.1	238	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	09/04/2021	21.4	51.5	11.7	12.7	245	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	12/04/2021	24.5	54.9	12.6	14.0	267	7.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	13/04/2021	22.5	51.6	10.2	11.9	205	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	22/04/2021	23.4	50.5	12.9	13.0	230	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6	23/04/2021	25.1	47.6	9.6	11.1	218	7.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
7	26/04/2021	23.6	51.4	11.2	13.5	278	7.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8	27/04/2021	21.4	58.8	12.1	12.1	209	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9 10	06/05/2021	21.5 24.3	51.6 49.5	9.4 12.3	12.6 14.3	223 230	4.8 5.4	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
10	07/05/2021 10/05/2021	24.3	49.5 56.3	12.3	14.3	230	5.4 6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	11/05/2021	22.0	52.6	9.5	12.9	197	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	20/05/2021	21.7	48.0	11.5	13.4	202	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	21/05/2021	24.0	50.3	10.4	12.7	202	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	24/05/2021	23.5	55.4	11.6	13.5	203	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	25/05/2021	23.7	53.6	10.2	13.0	232	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
17	03/06/2021	23.4	55.7	10.2	13.5	211	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
18	04/06/2021	21.7	51.6	11.1	14.8	218	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
19	07/06/2021	25.1	53.5	11.5	13.8	240	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	08/06/2021	23.6	54.7	10.4	12.5	185	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	17/06/2021	21.9	46.2	11.2	13.8	193	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
22	18/06/2021	24.2	54.7	12.4	14.1	194	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	21/06/2021	20.8	52.6	9.6	11.9	252	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
24	22/06/2021	21.5	47.5	12.5	14.2	223	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	01/07/2021	20.4	52.1	11.2	14.0	224	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	02/07/2021	20.2	46.7	10.4	12.5	206	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	06/07/2021	24.1	50.6	12.1	14.2	228	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	16/07/2021	20.6	52.6	9.7	12.3	205	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	19/07/2021	20.4	48.3	10.5	12.9	215	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	20/07/2021	22.7	53.1	11.7	13.2	182	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	29/07/2021	23.4	50.5	10.4	12.5	240	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32	30/07/2021	20.0	47.8	11.8	13.3	211	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	02/08/2021	22.2	48.1	10.8	12.3	236	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	03/08/2021	22.0	45.5	11.3	13.7	218	4.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	12/08/2021	19.7	51.7	9.9	12.0	233	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	13/08/2021	20.4	47.3	10.6	13.5	217	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	17/08/2021	22.2	50.4	11.4	14.1	227	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38 39	18/08/2021 26/08/2021	24.5 22.3	48.1 51.3	12.6 10.1	14.4 13.7	194 218	4.6 5.7	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
40	27/08/2021	22.3	49.9	10.1	14.5	218	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	30/08/2021	23.5	50.7	10.5	12.5	234	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	31/08/2021	24.5	47.5	12.2	14.1	206	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	09/09/2021	24.2	45.2	11.7	13.7	248	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	10/09/2021	20.3	50.3	12.0	15.0	229	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	13/09/2021	25.1	48.8	10.8	13.4	243	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	14/09/2021	23.0	44.5	11.4	12.6	228	4.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	23/09/2021	24.2	53.1	13.1	14.4	239	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	24/09/2021	21.7	45.3	12.2	15.0	205	4.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	28/09/2021	20.4	48.4	11.2	15.1	231	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	29/09/2021	23.6	52.7	10.6	12.8	234	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value	19.7	44.5	9.4	11.1	182	4.0	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	num value	25.1	58.8	13.1	15.1	278	7.9	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	age value	22.6	50.7	11.2	13.3	224	5.5	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	Percentile	25.1	56.4	12.9	15.0	267	7.4	<20	<1.0	<1.0	<1.0	<0.01	<0.01

AAQ2 - Appikonda village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	01/04/2021	27.1	51.6	10.5	12.0	242	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	02/04/2021	25.0	53.4	11.7	13.6	277	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	05/04/2021	26.1	45.7	10.8	12.5	283	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	06/04/2021	22.4	48.2	12.5	14.4	267	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5 6	15/04/2021 16/04/2021	25.6 23.4	54.6 43.2	9.4 13.0	12.6 15.1	201 233	7.4 5.8	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
7	19/04/2021	26.7	50.3	11.9	13.2	255	7.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8	20/04/2021	23.4	51.6	9.4	12.2	235	8.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	29/04/2021	22.0	48.5	12.4	14.6	254	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	30/04/2021	24.5	52.4	10.7	12.7	221	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	03/05/2021	25.1	49.6	12.3	14.1	271	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	04/05/2021	23.6	51.4	10.6	12.8	262	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	13/05/2021	22.6	52.7	11.2	13.5	268	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	14/05/2021	26.1	46.4	9.7	11.8	252	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	17/05/2021	24.7	52.1	10.2	12.4	197	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
16	18/05/2021	22.7	47.8	12.6	14.2	218	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
17	27/05/2021	25.0	51.7	9.9	11.9	240	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
18	28/05/2021	22.8	53.5	10.4	12.1	269	7.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
19	31/05/2021	26.3	50.7	11.7	13.5	239	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	01/06/2021	23.5	51.7	10.7	12.8	234	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	10/06/2021	24.9	52.1	11.5	13.7	231	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
22	11/06/2021	24.5	54.8	12.1	14.4	256	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	14/06/2021	22.7	48.5	10.9	13.1	240	5.7	<20	<1.0	<1.0	<1.0	<0.01	< 0.01
24	15/06/2021	23.5	50.3	10.6	12.5	188	6.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	24/06/2021	21.5	45.3	11.1	13.1	209	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	25/06/2021	23.8	49.9	12.2	14.5	231	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	28/06/2021	21.6	51.7	10.8	12.6	245	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	29/06/2021	24.2	48.9	11.3	12.8	230	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	08/07/2021	24.5	47.3	11.1	13.1	222	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	09/07/2021	21.4	49.1	10.8	12.8	219	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	12/07/2021	23.0	52.7	11.4	13.5	244	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32 33	13/07/2021	24.8 22.0	47.1 48.2	10.2 9.9	12.2 11.6	228 205	6.7 6.3	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
34	22/07/2021 23/07/2021	22.0	52.3	10.4	12.2	197	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	27/07/2021	20.0	47.8	11.5	13.6	219	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	28/07/2021	23.2	52.3	9.6	11.7	233	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	05/08/2021	21.6	49.2	10.9	13.1	235	4.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	06/08/2021	23.5	46.3	12.0	14.1	232	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	09/08/2021	25.1	50.7	10.5	12.0	248	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	10/08/2021	22.8	49.0	11.4	13.3	241	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	19/08/2021	23.5	53.3	10.3	12.7	218	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	21/08/2021	21.5	49.2	11.6	12.5	210	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	23/08/2021	24.1	46.6	12.0	13.4	232	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	24/08/2021	21.8	50.7	10.8	12.8	246	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	02/09/2021	23.6	51.3	11.9	14.5	247	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	03/09/2021	20.5	48.0	10.4	13.2	243	4.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	06/09/2021	23.4	47.8	12.5	13.4	225	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	07/09/2021	24.3	46.2	10.5	12.8	252	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	16/09/2021	21.8	50.4	11.3	14.1	233	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	17/09/2021	24.2	46.4	12.4	13.8	221	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
51	20/09/2021	22.4	50.2	10.8	13.2	244	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
52	21/09/2021	23.1	47.9	11.6	12.8	257	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
53	30/09/2021	21.5	45.6	12.3	14.2	251	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value mum value	<u>20.0</u> 27.1	43.2	9.4 13.0	11.6	<u>188</u> 284	4.2 8.2	<20 <20	<1.0 <1.0	<1.0	<1.0	<0.01	< 0.01
	age value	27.1	54.8 49.7	13.0	15.1 13.1	284	8.2 5.8	<20	<1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
	Percentile	25.5	54.6	12.6	13.1	238	7.4	<20	<1.0	<1.0	<1.0	< 0.01	
30UI	All the above										~T.0	- ~0.01	UI

				//	AAQ3 - E)evada v	illage						
Sr.No	Monitoring Date	PM2.5	PM10	SO₂	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	01/04/2021	21.6	52.3	10.8	13.7	255	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	02/04/2021	23.5	51.3	12.2	14.1	234	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	05/04/2021	25.5	47.0	11.3	14.5	204	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	06/04/2021	21.4	52.1	10.6	12.9	257	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	15/04/2021	22.0	53.2	13.1	15.2	223	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6 7	<u>16/04/2021</u> 19/04/2021	23.0 20.6	44.0 44.7	11.0 13.7	13.6 15.0	249 209	7.3 6.1	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
8	20/04/2021	20.8	52.5	13.7	13.1	209	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	29/04/2021	24.1	46.7	12.5	14.3	233	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	30/04/2021	24.6	50.2	10.9	14.5	233	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	03/05/2021	24.3	51.6	11.2	14.2	240	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	04/05/2021	22.6	54.7	10.5	12.6	202	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	13/05/2021	21.6	45.2	12.1	14.6	224	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	14/05/2021	24.4	50.7	10.4	12.6	242	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	17/05/2021	25.0	52.2	12.4	13.9	208	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
16	18/05/2021	24.2	45.4	10.3	12.5	234	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
17	27/05/2021	21.8	48.2	11.5	13.9	242	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
18	28/05/2021	23.8	53.9	13.2	14.8	213	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
19	31/05/2021	24.7	49.1	11.8	13.2	218	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	01/06/2021	21.6	48.3	12.1	14.0	228	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	10/06/2021	24.5	50.2	11.4	13.5	190	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
22	11/06/2021	23.5	47.3	9.6	12.1	212	4.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	14/06/2021	20.4	52.8	12.4	14.1	206	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
24	15/06/2021	23.8	50.4	11.3	13.3	199	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	24/06/2021	23.0	43.6	10.6	12.7	225	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	25/06/2021	20.6	46.4	11.2	13.2	211	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	28/06/2021	22.6	52.1	11.8	13.6	204	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	29/06/2021	23.5	47.3	10.5	12.9	209	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	08/07/2021	19.6	45.2	11.4	13.1	237	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	09/07/2021	22.4	48.1	10.7	12.6	245	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	12/07/2021	20.6	45.2	12.1	14.5	223	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32 33	13/07/2021 22/07/2021	19.6 22.3	50.7 48.3	13.1 10.6	15.2 12.4	194 222	4.8 6.2	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
33	23/07/2021	22.5	50.3	11.6	12.4	225	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	27/07/2021	23.7	44.3	10.5	12.3	223	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	28/07/2021	21.1	49.5	12.0	14.2	235	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	05/08/2021	21.1	47.1	12.0	14.2	250	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	06/08/2021	23.9	44.6	11.9	13.7	258	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	09/08/2021	24.1	48.1	9.6	12.7	236	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	10/08/2021	21.1	46.3	12.5	14.2	207	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	19/08/2021	23.8	43.6	11.8	13.5	235	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	21/08/2021	23.0	46.1	12.8	14.6	238	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	23/08/2021	20.1	44.8	11.7	13.4	221	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	24/08/2021	22.6	45.6	10.6	12.7	248	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	02/09/2021	24.5	49.3	11.3	13.2	262	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	03/09/2021	20.6	47.6	12.7	15.0	235	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	06/09/2021	22.6	45.2	10.5	14.2	248	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	07/09/2021	19.5	50.4	13.3	14.6	218	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	16/09/2021	22.1	48.5	10.9	14.9	247	6.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	17/09/2021	21.4	44.7	13.3	15.0	251	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
51	20/09/2021	23.6	47.3	12.3	14.6	234	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
52	21/09/2021	21.7	50.3	11.4	13.7	259	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
Minin	30/09/2021	24.5	47.3	13.2	14.9	241	5.6	<20	<1.0	<1.0	<1.0	<0.01 < 0.01	< 0.01
	num value	19.5 25 5	43.6	9.6 13.7	12.1	190	4.2	<20	<1.0	<1.0	<1.0	<0.01	
	num value age value	25.5 22.6	54.7 48.3	13.7 11.6	15.2 13.7	262 229	7.3 5.7	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01

AAQ-4 Cheepurupalle village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	01/04/2021	21.4	54.7	10.4	12.0	226	7.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	02/04/2021	19.5	47.5	12.3	14.6	234	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	05/04/2021	23.5	51.4	11.5	13.3	256	7.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	06/04/2021	25.2	47.6	10.8	12.7	186	8.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	15/04/2021	19.4	52.6	11.4	13.1	206	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6	16/04/2021	22.8	46.2	13.2	15.0	241	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
7	19/04/2021	24.2	54.6	10.5	13.2	250	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8 9	20/04/2021	22.5	52.4 51.6	12.5	14.7 13.5	203	6.3 5.4	<20	<1.0	<1.0 <1.0	<1.0	< 0.01	<0.01 <0.01
9 10	29/04/2021 30/04/2021	25.0 19.5	48.2	11.2 10.7	13.5	243 252	5.4 7.2	<20 <20	<1.0 <1.0	<1.0	<1.0 <1.0	<0.01 <0.01	< 0.01
10	03/05/2021	22.6	56.1	9.7	12.7	232	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	04/05/2021	22.0	48.9	11.6	13.5	211	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	13/05/2021	24.7	52.8	10.8	12.2	241	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	14/05/2021	26.4	49.0	10.0	11.6	206	7.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	17/05/2021	20.4	54.0	10.1	12.0	191	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
16	18/05/2021	24.0	47.6	12.5	13.9	226	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
17	27/05/2021	25.4	56.0	9.8	12.1	235	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
18	28/05/2021	23.7	53.8	11.8	13.6	217	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
19	31/05/2021	26.2	53.0	10.5	12.4	228	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	01/06/2021	24.5	58.2	10.6	11.8	199	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	10/06/2021	22.6	51.0	12.5	14.4	207	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
22	11/06/2021	21.8	54.9	11.7	13.1	263	7.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	14/06/2021	24.5	48.5	11.0	12.5	232	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
24	15/06/2021	19.4	52.2	12.4	12.3	182	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	24/06/2021	22.8	45.8	11.6	12.7	217	7.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	25/06/2021	24.2	54.2	13.4	14.6	226	4.9	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
27	28/06/2021	22.5	52.0	10.7	12.8	208	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	29/06/2021	25.0	51.2	12.7	14.3	219	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	08/07/2021	25.1	48.4	12.1	14.3	204	6.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	09/07/2021	20.5	55.7	11.8	13.5	225	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	12/07/2021	23.1	47.3	12.5	14.1	267	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32	13/07/2021	19.7	56.1	13.1	14.8	220	7.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	22/07/2021	21.4	50.1	11.7	14.1	211	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	23/07/2021	24.5	48.0	10.9	12.6	234	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	27/07/2021	22.7	51.6	12.7	14.0	214	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	28/07/2021	23.0	47.3	10.0	13.1	196	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37 38	05/08/2021	23.1	53.2	13.3	15.4	221	5.0 6.4	<20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	< 0.01
39	06/08/2021 09/08/2021	22.0 24.6	51.4 49.2	10.5 13.7	14.6 15.2	238 280	5.3	<20 <20	<1.0	<1.0	<1.0	< 0.01	<0.01 <0.01
40	10/08/2021	24.0	54.6	11.3	13.2	233	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	19/08/2021	26.2	52.0	10.8	12.9	233	7.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	21/08/2021	23.3	57.7	12.1	13.7	247	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	23/08/2021	25.3	55.1	13.9	15.1	227	7.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	24/08/2021	21.6	49.2	11.2	14.2	209	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	02/09/2021	21.4	50.3	14.2	16.0	235	7.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	03/09/2021	24.2	48.6	11.3	15.9	249	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	06/09/2021	22.8	59.4	14.1	16.2	267	8.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	07/09/2021	26.3	51.8	12.1	14.4	244	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	16/09/2021	24.5	49.1	11.8	13.3	237	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	17/09/2021	21.7	54.9	12.9	15.0	258	7.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
51	20/09/2021	26.8	52.1	14.2	16.3	242	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
52	21/09/2021	25.3	48.2	12.0	15.5	288	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
53	30/09/2021	22.7	50.5	13.5	15.1	231	5.3	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
Minin	num value	19.4	45.8	9.7	10.9	182	4.2	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	mum value	26.8	59.4	14.2	16.3	288	8.7	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	age value	23.1	51.7	11.8	13.7	229	6.2	<20	<1.0	<1.0	<1.0	<0.01	<0.01
98th	Percentile	26.4	58.2	14.2	16.2	279	8.0	<20	<1.0	<1.0	<1.0	<0.01	<0.01

AAQ-5 Dasaripeta village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O₃	NH₃	Pb	As	Ni	Вар	C6H6
1	08/04/2021	22.5	51.4	11.4	13.7	255.0	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	09/04/2021	21.5	47.6	10.6	12.7	268.0	7.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	12/04/2021	23.5	50.5	11.5	13.4	214.0	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	13/04/2021	20.6	47.0	10.1	12.4	267.0	6.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	22/04/2021	24.5	52.6	11.5	14.1	245.0	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6	23/04/2021	22.4	51.5	10.5	12.7	209.0	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
7	26/04/2021	23.7	45.7	12.4	14.6	257.0	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8	27/04/2021	21.3	48.6	10.4	13.1	229.0	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	06/05/2021	24.5	46.3	10.7	12.6	240.0	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	07/05/2021	22.7	49.0	12.1	14.2	253.0	6.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	10/05/2021	24.7	53.1	10.8	12.3	203.0	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	11/05/2021	21.8	48.4	10.3	12.1	252.0	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	20/05/2021	23.4	50.2	10.8	13.0	230.0	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	21/05/2021	24.7	52.9	11.2	14.0	216.0	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	24/05/2021	21.5	47.1 50.0	10.6	13.5	242.0	5.3	<20	<1.0	<1.0	<1.0	<0.01 <0.01	< 0.01
16	25/05/2021	25.1		12.1	14.4	214.0	6.2	<20	<1.0	<1.0	<1.0		< 0.01
17 18	03/06/2021	21.8 24.6	48.4 52.1	11.6 10.5	13.5 12.7	228.0 241.0	4.8 5.2	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
18	04/06/2021 07/06/2021	24.8	49.3	10.5	13.2	191.0	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	08/06/2021	23.7	50.5	10.5	12.4	240.0	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	17/06/2021	22.2	48.4	10.5	13.9	221.0	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	18/06/2021	23.5	51.1	10.6	13.7	207.0	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	21/06/2021	20.3	45.3	12.5	14.7	233.0	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
24	22/06/2021	23.9	48.2	11.5	13.2	205.0	5.8	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
25	01/07/2021	23.1	46.3	10.9	12.6	216.0	6.1	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
26	02/07/2021	20.4	49.2	11.6	13.2	229.0	4.6	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
27	06/07/2021	19.6	50.1	11.0	12.3	234.0	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	16/07/2021	21.9	48.4	12.2	14.1	228.0	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	19/07/2021	20.7	44.7	10.5	13.0	209.0	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	20/07/2021	23.4	49.0	11.2	13.6	216.0	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	29/07/2021	24.1	47.1	10.2	12.7	221.0	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32	30/07/2021	22.4	45.7	12.0	13.8	231.0	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	02/08/2021	20.4	49.2	11.8	13.8	228.0	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	03/08/2021	23.3	51.3	12.5	14.4	241.0	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	12/08/2021	21.4	48.2	10.6	13.5	246.0	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	13/08/2021	23.7	50.5	13.1	15.0	240.0	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	17/08/2021	22.5	46.8	11.4	14.2	221.0	4.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	18/08/2021	20.1	51.1	10.8	13.2	228.0	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	26/08/2021	22.8	49.2	11.1	12.5	233.0	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	27/08/2021	24.2	47.8	12.9	14.5	243.0	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	30/08/2021	20.4	50.3	10.4	12.4	223.0	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	31/08/2021	22.1	48.1	12.1	13.8	218.0	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	09/09/2021	23.1	46.3	12.8	14.7	241.0	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	10/09/2021	21.6	48.5	11.4	13.7	252.0	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	13/09/2021	19.8	45.3	11.5	14.7	258.0	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	14/09/2021	21.8	47.7	10.5	12.8	251.0	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	23/09/2021	20.9	49.5	12.4	14.2	235.0	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	24/09/2021	25.2	48.3	11.6	13.3	239.0	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	28/09/2021	21.2	46.5	12.3	14.1	247.0	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	29/09/2021	22.3	45.0	10.5	13.4	254.0	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value	19.6 25.2	44.7 53.1	10.1 13.1	12.1	191 268	4.2 7.7	<20	<1.0	<1.0	<1.0 <1.0	<0.01 <0.01	< 0.01
	num value age value	25.2	48.7	13.1	15.0 13.5	268	5.6	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0	< 0.01	<0.01 <0.01
								<20	1	<1.0	<1.0		< 0.01
	Percentile	25.1	52.9	12.9	14.7	267	7.1		<1.0		~1.0	<0.01	0.01

AAQ-6 Islampeta village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	08/04/2021	23.3	50.3	11.4	13.3	227	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	09/04/2021	19.5	47.5	10.4	12.6	218	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	12/04/2021	21.5	52.4	12.1	14.3	235	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	13/04/2021	23.4	47.6	10.5	12.4	206	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	22/04/2021	24.4	50.3	11.4	13.4	216	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6	23/04/2021	20.5	52.0	10.7	12.7	224	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
7	26/04/2021	19.5	48.6	9.8	11.2	237	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8	27/04/2021	22.4	46.2	12.5	14.1	231	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	06/05/2021	24.5	51.7	10.7	12.2	212	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	07/05/2021	20.7	48.9	9.7	11.5	203	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	10/05/2021	22.7	53.8	11.4	13.2	220	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	11/05/2021	24.6	49.0	12.2	14.0	191	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	20/05/2021	25.6	51.7	10.7	12.3	201	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	21/05/2021	21.7	53.4	10.0	11.6	209	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	24/05/2021	20.7	50.0 47.6	12.0	14.1 13.0	222	4.6 5.1	<20	<1.0	<1.0	<1.0	<0.01 <0.01	< 0.01
16	25/05/2021	23.6		11.8		216		<20	<1.0	<1.0	<1.0		< 0.01
17 18	03/06/2021 04/06/2021	25.1 22.6	47.3 50.5	11.6 10.6	13.1 12.4	200 191	4.7 5.5	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
18	07/06/2021	22.6	46.4	10.8	12.4	208	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	08/06/2021	24.0	51.1	12.3	13.8	179	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	17/06/2021	24.4	49.9	10.5	13.1	192	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	18/06/2021	20.5	51.6	11.6	13.5	200	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	21/06/2021	19.5	48.2	10.9	12.3	213	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	22/06/2021	22.4	45.8	12.1	14.5	207	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	01/07/2021	24.0	45.2	10.9	12.7	226	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	02/07/2021	20.1	48.4	9.5	12.4	202	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	06/07/2021	21.6	45.3	11.6	13.2	196	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	16/07/2021	24.7	49.0	10.7	12.9	205	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	19/07/2021	22.5	45.6	12.3	14.2	182	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	20/07/2021	23.6	49.5	10.5	12.8	201	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	29/07/2021	20.7	46.1	9.8	12.0	201	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32	30/07/2021	23.1	48.1	11.4	13.6	195	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	02/08/2021	21.5	47.3	11.8	14.1	238	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	03/08/2021	24.2	50.5	10.4	13.6	214	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	12/08/2021	23.4	47.4	9.0	12.3	208	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	13/08/2021	21.0	52.3	11.6	14.2	217	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	17/08/2021	24.3	47.7	10.4	13.2	224	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	18/08/2021	25.4	51.6	11.4	14.0	213	4.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	26/08/2021	22.5	48.2	10.7	13.2	213	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	27/08/2021	24.9	50.2	12.5	14.8	207	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	30/08/2021	21.5	48.3	10.4	12.6	234	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	31/08/2021	23.1	46.6	11.5	14.8	204	4.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	09/09/2021	25.3	52.5	12.1	15.6	245	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	10/09/2021	22.6	47.7	11.2	14.9	225	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	13/09/2021	20.8	50.3	10.1	13.7	221	4.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	14/09/2021	24.1	49.5	12.4	15.5	228	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	23/09/2021	22.5	51.3	11.3	14.8	236	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	24/09/2021	25.0	48.8	12.2	15.3	224	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	28/09/2021	20.6	45.3	11.6	14.6	227	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	29/09/2021	23.3	47.4	13.1	15.3	244	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value	19.5	45.2	9.0	11.2	179	4.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value	25.6	53.8	13.1	15.6	245	7.1	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	age value	22.7	49.0	11.2	13.5	214	5.4	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
	Percentile	25.4	53.4	12.5	15.5	244	6.7	<20	<1.0	<1.0	<1.0	<0.01	<0.01

	AAQ-7 Pittavanipalem village												
Sr.No	Monitoring Date	PM2.5	PM10	SO₂	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	C6H6
1	01/04/2021	23.5	56.6	12.3	14.6	265	7.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	02/04/2021	26.7	52.8	11.6	14.1	257	6.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	05/04/2021	23.4	60.5	10.6	12.3	261	7.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	06/04/2021	26.4	57.4	13.1	15.0	250	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	15/04/2021	23.7	46.7	10.5	12.5	247	8.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
<u>6</u> 7	16/04/2021 19/04/2021	27.3 24.2	50.6 56.3	12.4 11.0	14.3 13.7	266 212	4.8 6.6	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
8	20/04/2021	24.2	47.5	10.1	13.7	259	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	29/04/2021	20.5	55.6	12.5	14.6	235	7.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	30/04/2021	25.1	48.4	10.7	13.5	251	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	03/05/2021	26.0	58.0	11.6	13.5	250	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	04/05/2021	24.3	54.2	10.9	12.6	242	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	13/05/2021	25.1	61.9	11.2	13.7	246	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	14/05/2021	23.7	59.2	12.6	15.2	235	7.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	17/05/2021	26.2	48.1	11.3	13.2	232	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
16	18/05/2021	22.5	54.1	10.6	13.2	251	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
17	27/05/2021	23.5	57.7	12.4	14.8	203	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
18	28/05/2021	25.2	48.9	11.6	13.3	244	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
19	31/05/2021	24.6	57.0	10.8	12.8	220	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	01/06/2021	22.8	63.2	12.5	14.4	238	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
21	10/06/2021	26.2	56.3	11.8	13.5	225	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
22	11/06/2021	27.0	49.5	12.1	14.6	234	6.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23	14/06/2021	25.6	61.3	11.5	13.8	223	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
24	15/06/2021	25.0	46.3	13.5	15.9	223	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
25	24/06/2021	21.3	52.3	12.2	13.9	242	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
26	25/06/2021	22.3	55.9	11.5	13.9	194	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	28/06/2021	24.0	47.1	13.3	15.5	235	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
28	29/06/2021	23.4	55.2	12.5	14.0	211	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
29	08/07/2021	20.5	58.2	11.8	13.5	226	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
<u> </u>	09/07/2021	24.7	54.2 58.3	11.1 13.1	12.6 15.0	213	4.8 5.7	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	<0.01 <0.01
32	12/07/2021 13/07/2021	26.2 23.2	59.2	10.8	12.9	245 211	4.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	22/07/2021	25.2	48.2	10.8	12.9	211	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	23/07/2021	22.6	50.2	11.5	13.0	230	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	27/07/2021	24.1	60.3	10.8	13.0	241	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	28/07/2021	21.6	52.1	12.6	14.6	223	6.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	05/08/2021	22.0	57.2	13.0	14.6	239	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	06/08/2021	26.0	56.1	12.3	13.7	226	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	09/08/2021	22.4	58.2	11.5	12.5	257	4.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	10/08/2021	24.7	62.3	12.0	14.0	224	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	19/08/2021	23.5	50.1	13.7	14.5	224	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
42	21/08/2021	25.1	52.1	10.8	13.3	243	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	23/08/2021	25.6	49.3	12.0	14.1	254	5.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	24/08/2021	23.1	54.0	13.8	15.3	236	5.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
45	02/09/2021	24.8	54.3	11.8	13.8	252	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
46	03/09/2021	22.7	53.3	10.7	14.2	237	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	06/09/2021	23.9	55.4	12.5	14.5	271	6.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	07/09/2021	25.2	59.5	11.6	13.3	235	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49 50	16/09/2021	21.6	60.3	10.6	12.6	238	6.5	<20	<1.0	<1.0	<1.0	<0.01 <0.01	< 0.01
50 51	17/09/2021 20/09/2021	23.5 25.8	51.3 56.8	11.6 12.9	14.6 13.8	254 267	6.1 5.1	<20 <20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01	<0.01 <0.01
51	21/09/2021	25.8	50.8	12.9	13.8	267	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
53	30/09/2021	21.3	53.6	12.5	14.8	247	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	num value	20.5	46.3	10.1	12.3	194	4.2	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	mum value	27.3	63.2	13.8	15.9	271	8.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	rage value	24.2	54.6	11.8	13.9	238	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	Percentile	27.0	62.3	13.7	15.5	267	7.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
	Il the above va												

AAQ-8 Kalapaka village													
Sr.No	Monitoring Date	PM2.5	PM10	SO 2	NO ₂	со	O 3	NH₃	Pb	As	Ni	Вар	С6Н6
1	08/04/2021	23.6	44.6	11.6	13.6	219	7.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
2	09/04/2021	20.3	53.8	10.6	12.3	237	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
3	12/04/2021	22.4	48.6	10.9	12.1	222	6.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
4	13/04/2021	24.5	50.7	12.1	14.7	253	7.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
5	22/04/2021	22.8	51.5	10.4	13.0	227	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
6	23/04/2021	21.0	46.3	11.7	13.2	210	6.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
7	26/04/2021	19.6	50.6	11.3	13.7	221	4.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
8	27/04/2021	21.5	52.6	12.0	14.4	248	5.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
9	06/05/2021	25.1	52.3	10.9	12.5	243	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
10	07/05/2021	23.6	49.3	11.6	14.1	222	7.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
11	10/05/2021	21.9	51.3	10.2	12.5	261	5.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
12	11/05/2021	25.1	46.3	11.4	13.8	238	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
13	20/05/2021	21.5	54.2	12.0	14.2	212	7.0 5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
14	21/05/2021	24.2	49.6	11.0	13.7	206		<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
15	24/05/2021	22.6	50.3	10.6	12.6 13.3	241	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
16	25/05/2021	20.2	54.0	11.3	13.3	233	5.1	<20	<1.0	<1.0	<1.0	<0.01 <0.01	< 0.01
17	03/06/2021	23.1	55.3	11.8		231	6.5	<20	<1.0	<1.0	<1.0		< 0.01
18	04/06/2021	25.5	51.4 53.4	12.5	14.2	210	5.3 7.2	<20	<1.0	<1.0	<1.0	<0.01 <0.01	<0.01 <0.01
19	07/06/2021	23.8		11.1	13.4	249		<20	<1.0	<1.0	<1.0		
20 21	08/06/2021	19.7 20.3	48.4 52.4	12.3 10.6	14.7 12.8	252 203	6.6 5.7	<20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	<0.01 <0.01	< 0.01
21	17/06/2021		47.8				5.9	<20					< 0.01
	18/06/2021	23.0		12.9	14.9	197		<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
23 24	21/06/2021	21.4	48.5 52.2	11.9	14.4 13.3	232 224	6.8 5.8	<20	<1.0	<1.0	<1.0 <1.0	<0.01 <0.01	< 0.01
24 25	22/06/2021 01/07/2021	19.0 20.5	52.2	11.5 11.9		224	5.8	<20 <20	<1.0	<1.0		<0.01	< 0.01
25	02/07/2021	20.5	47.2	11.9	14.0 13.3	219	4.7	<20	<1.0 <1.0	<1.0 <1.0	<1.0 <1.0	< 0.01	<0.01 <0.01
20	06/07/2021	20.6	54.1	10.4	12.5	240	6.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
27	16/07/2021	25.1	46.3	11.6	13.8	216	6.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
20	19/07/2021	23.1	50.3	10.3	12.6	191	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
30	20/07/2021	21.5	45.7	11.6	14.2	206	5.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
31	29/07/2021	24.5	51.6	12.6	13.5	200	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
32	30/07/2021	20.2	49.3	10.8	12.4	212	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
33	02/08/2021	19.8	46.3	10.7	13.2	231	4.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
34	03/08/2021	21.7	49.3	12.4	14.5	252	6.5	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
35	12/08/2021	23.6	56.2	11.3	13.7	249	5.2	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
36	13/08/2021	24.1	47.2	12.8	14.8	228	4.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
37	17/08/2021	22.6	52.4	11.2	13.8	203	5.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
38	18/08/2021	21.8	47.8	12.5	14.3	218	4.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
39	26/08/2021	24.2	53.7	10.8	14.7	232	5.9	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
40	27/08/2021	22.0	51.4	11.7	13.6	224	4.7	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
41	30/08/2021	24.1	53.4	12.6	14.7	198	5.5	<20	<1.0		<1.0	< 0.01	< 0.01
42	31/08/2021	20.6	49.8	10.5	12.5	233	4.8	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
43	09/09/2021	22.5	54.3	11.7	14.7	245	6.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
44	10/09/2021	20.8	50.6	12.2	13.9	263	5.8	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
45	13/09/2021	24.7	53.2	10.4	15.2	261	7.0	<20	<1.0	<1.0	<1.0	< 0.01	<0.01
46	14/09/2021	22.5	48.2	13.0	15.2	239	5.4	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
47	23/09/2021	23.1	49.3	12.4	14.4	218	6.3	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
48	24/09/2021	20.2	52.4	10.5	12.5	229	4.6	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
49	28/09/2021	22.3	50.7	11.8	13.4	248	5.1	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
50	29/09/2021	24.8	48.6	12.5	14.9	235	4.0	<20	<1.0	<1.0	<1.0	< 0.01	< 0.01
Minimum value		19.0	44.6	10.2	12.1	191	4.0	<20	<1.0	<1.0	<1.0	<0.01	<0.01
Maximum value		25.5	56.2	13.0	15.2	263	7.4	<20	<1.0	<1.0	<1.0	<0.01	<0.01
	age value	22.4	50.5	11.5	13.7	229	5.7	<20	<1.0		<1.0	<0.01	<0.01
	Percentile	25.1	55.3	12.9	15.2	261	7.2	<20	<1.0		<1.0	<0.01	<0.01



ANNEXURE-II WATER BALANCE DIAGRAM

